

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 05/05/2024 to 05/11/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
5/6/2024	12:01 AM		9M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:02 AM		9M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:05 AM		9M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:06 AM		9M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:09 AM		9W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:10 AM		9W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:11 AM		9W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:20 AM		C907-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
5/6/2024	12:49 AM		8M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:50 AM		8M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:54 AM		8W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:55 AM		8W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	12:56 AM		8W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:05 AM		8M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:06 AM		8M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:09 AM		8W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:10 AM		8W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:11 AM		8W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:18 AM		C807-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
5/6/2024	1:22 AM		7W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:23 AM		7W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:24 AM		7W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:32 AM		7M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.4
5/6/2024	1:33 AM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:40 AM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.1
5/6/2024	1:41 AM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			2.8
5/6/2024	1:43 AM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:44 AM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:45 AM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	1:53 AM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
5/6/2024	2:08 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:08 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:17 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:17 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:28 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.9		
5/6/2024	2:35 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.1		
5/6/2024	2:36 AM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:37 AM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:38 AM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:45 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:47 AM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:48 AM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:56 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:56 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:57 AM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:57 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	2:58 AM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:00 AM		6W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:00 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:01 AM		6W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:02 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:02 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:10 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	68	1.24	
5/6/2024	3:10 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	67	1.21	
5/6/2024	3:12 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
5/6/2024	3:16 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:17 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:17 AM		LLM-1 Men-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:18 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:26 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:26 AM		LLM-1 Men-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:26 AM		LLW-1 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:26 AM		LLW-1 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/6/2024	3:27 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

5/6/2024	3:32 AM	CLL09-1 Janitor's Closet - Mop/Slop Sink	1	✓	□		2.0		
5/6/2024	3:39 AM	5M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	3:41 AM	5M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	3:43 AM	5W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	3:44 AM	5W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/6/2024	3:45 AM	5W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	3:52 AM	6W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	3:52 AM	C507 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.6		
5/6/2024	3:59 AM	E201 Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
5/6/2024	7:18 AM	4W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	7:18 AM	4W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/6/2024	7:20 AM	4W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	7:24 AM	4M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	7:24 AM	4M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	7:29 PM	4M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	7:29 PM	4M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	7:33 PM	4W-2 Women West-Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	7:33 PM	4W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/6/2024	7:34 PM	4W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	7:36 PM	C407 Janitor's Closet-Mop/Slop Sink	1	✓	□		1.8		
5/6/2024	7:40 PM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	7:41 PM	3W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/6/2024	7:41 PM	3W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	7:44 PM	3M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	7:45 PM	3M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	7:53 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	7:56 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	7:56 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/6/2024	7:56 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	8:08 PM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	8:09 PM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	8:11 PM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	8:11 PM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/6/2024	8:11 PM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	8:21 PM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	8:23 PM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	8:26 PM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	8:26 PM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/6/2024	8:26 PM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	8:31 PM	C207 Janitor's Closet-Mop/Slop Sink	1	✓	□				
5/6/2024	10:38 PM	10M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	10:39 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	10:43 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/6/2024	10:44 PM	10W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	10:45 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	10:54 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	10:55 PM	10M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	10:59 PM	10W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/6/2024	11:00 PM	10W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/6/2024	11:01 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	11:06 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.7		
5/6/2024	11:09 PM	Suite 1015 GSA Kitchenette Faucet (1000-03)	2	✓	□	1.5	1.3	1.3	
5/6/2024	11:48 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/6/2024	11:49 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/6/2024	11:50 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/7/2024	8:10 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.2	1.2	
5/7/2024	8:14 AM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	□	1.5		0.32	
5/7/2024	8:40 AM	Suite 608 Kitchen - Faucet	2	✓	✓	1.5	1.2	1.3	
5/7/2024	8:55 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	✓	1.5	1.3	1.3	
5/7/2024	8:58 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5		0.34	
5/7/2024	9:00 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	✓	1.5	1.2	1.3	
5/7/2024	9:10 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.2	1.2	
5/7/2024	9:15 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.2	1.2	
5/7/2024	9:25 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.2	1.5	
5/7/2024	9:55 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.2	1.1	
5/7/2024	10:15 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.2	1.3	
5/7/2024	10:30 AM	Suite 908 Break Room Faucet (908-15)	2	✓	✓	1.5	1.2	1.2	
5/7/2024	10:45 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.3	1.3	
5/7/2024	10:58 AM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.2	1.2	
5/7/2024	11:10 AM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.2	1.1	
5/7/2024	12:45 PM	Suite 532 Lactation Room - Faucet	2	✓	✓	1.5	1.2	1.1	
5/7/2024	12:55 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.2	1.3	
5/7/2024	1:05 PM	540 Faucet (507-26) A (Second fixture)	2	✓	✓	1.5	1.3	1.4	
5/7/2024	1:10 PM	540 Faucet (507-26)	2	✓	□	1.5	1.1	1.1	

5/7/2024	1:25 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.2	1.2	
5/7/2024	1:42 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.2	1.1	
5/7/2024	2:05 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.2	1.2	
5/7/2024	2:15 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1.2	1.3	
5/7/2024	2:30 PM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.2	1.2	
5/7/2024	2:40 PM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
5/7/2024	11:35 PM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.2	1.2	
5/7/2024	11:25 AM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.1	1.2	
5/8/2024	8:18 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.03	1.03	
5/8/2024	8:18 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5			0.61
5/8/2024	8:51 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.25	1.2	
5/8/2024	9:12 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.11	1.15	
5/8/2024	9:23 AM	234 Kitchen Faucet (209-04)	2	✓	□	1.5	1.25	1.25	
5/8/2024	9:45 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	□	1.5	1.3	1.3	
5/8/2024	9:59 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	□	1.5	1.3	1.25	
5/8/2024	10:14 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	□	1.5	1.11	1.07	
5/8/2024	10:29 AM	GSA Suite Kitchenette-Sink/Faucet	2	✓	□	1.5	0.85	1.2	
5/8/2024	10:38 AM	128-04 Lactation Room D-Sink/Faucet	2	✓	□	1.5	1.07	1.07	
5/8/2024	10:50 AM	128-03 Lactation Room C-Sink/Faucet	2	✓	□	1.5	1.03	1.07	
5/8/2024	11:02 AM	128-02 Lactation Room B-Sink/Faucet	2	✓	□	1.5	1.11	1.15	
5/8/2024	11:13 AM	128-01 Lactation Room A-Sink/Faucet	2	✓	□	1.5	1.03	1.07	
5/8/2024	11:23 AM	123-05 Health Unit - Sink/Faucet	2	✓	□	0.5			1.15
5/8/2024	11:52 AM	123-08 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
5/8/2024	12:05 PM	123-07 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
5/8/2024	1:29 PM	126-05 Men-Lavatory Faucet-Left	2	✓	□	0.5			0.48
5/8/2024	1:46 PM	126-05 Men-Lavatory Faucet-Center	2	✓	□	0.5			0.48
5/8/2024	1:46 PM	126-05 Men-Lavatory Faucet-Right	2	✓	□	0.5			
5/8/2024	1:58 PM	126-06 Shower Room - Shower-North-Left	1	✓	□	2			2.3
5/8/2024	1:58 PM	126-06 Shower Room-Shower-North-Center	1	✓	□	2			2.5
5/8/2024	1:58 PM	126-06 Shower Room - Shower-North-Right	1	✓	□	2			2.5
5/8/2024	1:58 PM	126-06 Shower Room - Shower-South-Left	1	✓	□	2			2.5
5/8/2024	2:04 PM	126-06 Shower Room-Shower-South-Center	1	✓	□	2			2.3
5/8/2024	2:04 PM	126-06 Shower Room - Shower-South-Right	1	✓	□	2			2.72
5/8/2024	4:11 PM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5		0.48	0.48
5/8/2024	4:11 PM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5		0.48	0.48
5/8/2024	4:11 PM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/8/2024	4:37 PM	126-03 Women-Shower-1st from L to R	1	✓	□	2			2.72
5/8/2024	4:37 PM	126-03 Women-Shower-2nd from L to R	1	✓	□	2			2.72
5/8/2024	4:37 PM	126-03 Women-Shower-3rd from L to R	1	✓	□	2			2.72
5/8/2024	4:37 PM	126-03 Women-Shower-4th from L to R	1	✓	□	2			2.72
5/8/2024	4:53 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	□	1.5	2.3	1.76	
5/8/2024	5:47 PM	Print, Postal Sorting Area Faucet	2	✓	□		2.00	1.58	
5/8/2024	6:00 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	1.03	0.98	
5/8/2024	6:13 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
5/8/2024	6:27 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
5/8/2024	8:21 PM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6			
5/8/2024	8:21 PM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6			
5/8/2024	8:21 PM	119-08 Toilet/Sink Combo-Right	2	✓	□	1.6			
5/8/2024	8:21 PM	119-10 Toilet/Sink Combo	2	✓	□	1.6			
5/8/2024	8:21 PM	119-07 Toilet/Sink Combo-Right	2	✓	□	1.6			
5/8/2024	8:21 PM	119-11 Toilet/Sink Combo	2	✓	□	1.6			
5/8/2024	8:21 PM	119-16A Shower	2	✓	□				
5/8/2024	8:21 PM	119-17 Toilet/Sink Combo	2	✓	□	1.6			
5/8/2024	8:21 PM	119-19 Food Storage Room-Sink/Faucet	2	✓	□	1.6	2.1	0.92	
5/8/2024	8:21 PM	119-21 Faucet/Eyewash	2	✓	□		2.7	0.96	

**985 Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 05/05/2024 to 05/11/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
5/7/2024	2944419	Suite. 540 Kitchenette - Faucet
5/8/2024	2944221	Suite 410 Kitchenette Faucet (NW)
5/8/2024	2944222	Suite 415 Kitchenette - Faucet (N)
5/8/2024	2944422	119-02 Mailroom - Faucet

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 05/12/2024 to 05/18/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
5/13/2024	12:15 AM		2M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:16 AM		2M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:18 AM		2W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:19 AM		2W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:20 AM		2W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:33 AM		2M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:34 AM		2M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:36 AM		2W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:37 AM		2W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:38 AM		2W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:48 AM		C207 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>				
5/13/2024	12:53 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:54 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	12:55 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:07 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:08 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:09 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:12 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.1		
5/13/2024	1:15 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.3	
5/13/2024	1:28 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:28 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:31 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:32 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:32 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:33 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:34 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:42 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:43 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:45 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
5/13/2024	1:47 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:49 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.9		
5/13/2024	1:55 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	1:55 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	2:00 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	2:00 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	2:01 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	2:16 AM		CLL09-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
5/13/2024	2:27 AM		LLM-1 Men-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	2:28 AM		LLM-1 Men-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	2:30 AM		LLW-1 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	2:30 AM		LLW-1 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	2:48 AM		Suite 1015 GSA Kitchenette Faucet (1000-03)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.24	0.88	
5/13/2024	7:30 PM		10W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:31 PM		10W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:31 PM		10W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:38 PM		10M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:38 PM		10M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:45 PM		10M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:46 PM		10M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:47 PM		10W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:47 PM		10W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:48 PM		10W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:52 PM		C1007-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.9		
5/13/2024	7:56 PM		9W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:57 PM		9W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:57 PM		9W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:57 PM		9M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	7:58 PM		9M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	8:04 PM		9M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	8:04 PM		9M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	8:07 PM		9W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	8:07 PM		9W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	8:07 PM		9W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/13/2024	8:09 PM		C907-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2		

5/13/2024	8:25 PM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/13/2024	8:25 PM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	8:25 PM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	8:30 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	8:30 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	8:34 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	8:34 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	8:35 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/13/2024	8:39 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	8:39 PM	8W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	8:48 PM	C807-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.8		
5/13/2024	8:51 PM	7W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	8:51 PM	7W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/13/2024	8:56 PM	7W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	8:59 PM	7M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	8:59 PM	7M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	9:01 PM	7M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	9:02 PM	7M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	9:06 PM	7W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	9:06 PM	7W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/13/2024	9:06 PM	7W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	9:08 PM	C707-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.8		
5/13/2024	9:15 PM	6W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	9:15 PM	6W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/13/2024	9:15 PM	6W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	9:18 PM	6M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	9:18 PM	6M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	9:25 PM	6M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	9:28 PM	6M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	9:32 PM	6W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	9:33 PM	6W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/13/2024	9:33 PM	6W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	9:41 PM	C607-Janitor's Closet - Mop/Slop Sink	1	✓	□		1.7		
5/13/2024	9:54 PM	C407 Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
5/13/2024	9:58 PM	4M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	9:59 PM	4M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	10:01 PM	4W-2 Women West-Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	10:02 PM	4W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/13/2024	10:03 PM	4W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	10:14 PM	4M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	10:15 PM	4M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	10:17 PM	4W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	10:18 PM	4W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/13/2024	10:19 PM	4W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	10:31 PM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	10:32 PM	3W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/13/2024	10:33 PM	3W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	10:42 PM	3M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	10:43 PM	3M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	10:54 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	10:55 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/13/2024	10:56 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/13/2024	10:57 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/13/2024	11:20 PM	E201 Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
5/13/2024	:23 AM	108-4 Cafe Prep. - Kitchen Faucet-Large	1	✓	□	1.5	1.3	1.3	
5/14/2024	8:14 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.19	1.2	
5/14/2024	8:14 AM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	□	1.5		0.75	
5/14/2024	8:38 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.4	1.42	
5/14/2024	9:00 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.3	1.25	
5/14/2024	9:18 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.472	1.3	
5/14/2024	9:33 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.36	1.2	
5/14/2024	9:53 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.3	1.2	
5/14/2024	10:10 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.15	1.2	
5/14/2024	10:30 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.2	1.11	
5/14/2024	10:50 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.2	1.07	
5/14/2024	11:05 AM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.3	1.2	
5/14/2024	11:25 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.2	1.3	
5/14/2024	11:40 AM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.2	1.11	
5/14/2024	1:42 PM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.2	1.15	
5/14/2024	1:55 PM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
5/14/2024	2:10 PM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.25	1.3	
5/14/2024	2:22 PM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.2	1.2	
5/14/2024	2:23 PM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.11	1.15	
5/14/2024	2:50 PM	540 Faucet (507-26)	2	✓	□	1.5	1.11	1.11	

5/14/2024	3:12 PM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.5	1.15	1.2
5/14/2024	3:20 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.2	1.2
5/14/2024	3:45 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.2	1.15
5/14/2024	4:00 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.2	1.2
5/14/2024	4:15 PM	Suite 532 Lactation Room - Faucet	2	✓	□	1.5	1.15	1.15
5/14/2024	4:30 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.2	1.11
5/15/2024	8:45 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.2	1.1
5/15/2024	8:50 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5		0.34
5/15/2024	9:05 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.3	1.2
5/15/2024	9:20 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.3	1.3
5/15/2024	9:35 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	✓	1.5	1.2	1.3
5/15/2024	9:49 AM	234 Kitchen Faucet (209-04)	2	✓	□	1.5	1.3	1.2
5/15/2024	10:00 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	□	1.5	1.2	1.2
5/15/2024	10:15 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	□	1.5	1.3	1.3
5/15/2024	10:30 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	□	1.5	1.2	1.2
5/15/2024	10:38 AM	123-05 Health Unit - Sink/Faucet	2	✓	□	0.5		1.2
5/15/2024	10:40 AM	123-07 Health Unit-Lavatory Faucet	2	✓	□	0.5		0.48
5/15/2024	10:45 AM	123-08 Health Unit-Lavatory Faucet	2	✓	□	0.5		0.48
5/15/2024	11:05 AM	GSA Suite Kitchenette-Sink/Faucet	2	✓	□	1.5	1.2	1.2
5/15/2024	11:08 AM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5		0.48
5/15/2024	11:08 AM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5		0.48
5/15/2024	11:08 AM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5		0.48
5/15/2024	11:11 AM	126-06 Shower Room - Shower-North-Left	1	✓	□	2		2.5
5/15/2024	11:11 AM	126-06 Shower Room-Shower-North-Center	1	✓	□	2		2.5
5/15/2024	11:11 AM	126-06 Shower Room - Shower-North-Right	1	✓	□	2		2.5
5/15/2024	11:11 AM	126-06 Shower Room - Shower-South-Left	1	✓	□	2		2.5
5/15/2024	11:11 AM	126-06 Shower Room-Shower-South-Center	1	✓	□	2		2.5
5/15/2024	11:11 AM	126-06 Shower Room - Shower-South-Right	1	✓	□	2		2.5
5/15/2024	11:15 AM	126-03 Women-Shower-1st from L to R	1	✓	□	2		2.5
5/15/2024	11:15 AM	126-03 Women-Shower-2nd from L to R	1	✓	□	2		2.5
5/15/2024	11:15 AM	126-03 Women-Shower-3rd from L to R	1	✓	□	2		2.5
5/15/2024	11:15 AM	126-03 Women-Shower-4th from L to R	1	✓	□	2		2.5
5/15/2024	11:15 AM	126-05 Men-Lavatory Faucet-Left	2	✓	□	0.5		0.48
5/15/2024	11:15 AM	128-01 Lactation Room A-Sink/Faucet	2	✓	□	1.5	1.2	1.2
5/15/2024	11:17 AM	126-05 Men-Lavatory Faucet-Center	2	✓	□	0.5		0.48
5/15/2024	11:17 AM	126-05 Men-Lavatory Faucet-Right	2	✓	□	0.5		0.48
5/15/2024	11:18 AM	128-02 Lactation Room B-Sink/Faucet	2	✓	✓	1.5	1.3	1.3
5/15/2024	11:20 AM	128-03 Lactation Room C-Sink/Faucet	2	✓	✓	1.5	1.2	1.2
5/15/2024	11:22 AM	128-04 Lactation Room D-Sink/Faucet	2	✓	✓	1.5	1.2	1.3
5/15/2024	12:45 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5		0.48
5/15/2024	12:55 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5		0.48
5/15/2024	1:05 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	1.2	1.2
5/15/2024	1:20 PM	Print, Postal Sorting Area Faucet	2	✓	□		1.4	1.5
5/15/2024	1:50 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	□	1.5	1.3	1.3
5/15/2024	9:08 PM	119-02 Mailroom - Faucet	2	✓	□		1.2	1.5
5/15/2024	9:08 PM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6		
5/15/2024	9:08 PM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6		
5/15/2024	9:08 PM	119-08 Toilet/Sink Combo-Right	2	✓	□	1.6		
5/15/2024	9:08 PM	119-10 Toilet/Sink Combo	2	✓	□	1.6		
5/15/2024	9:08 PM	119-07 Toilet/Sink Combo-Right	2	✓	□	1.6		
5/15/2024	9:08 PM	119-11 Toilet/Sink Combo	2	✓	□	1.6		
5/15/2024	9:08 PM	119-16A Shower	2	✓	□			1.5
5/15/2024	9:08 PM	119-17 Toilet/Sink Combo	2	✓	□	1.6		
5/15/2024	9:08 PM	119-21 Faucet/Eyewash	2	✓	□		1.1	1.5
				□	□			

**985 Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 05/12/2024 to 05/18/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
5/14/2024	2944419	Suite. 540 Kitchenette - Faucet
5/14/2024	2945145	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)
5/14/2024	2944260	Suite 520 Kitchenette Faucet (508-13)
5/15/2024	2944222	Suite 415 Kitchenette - Faucet (N)
5/15/2024	2944089	119-19 Food Storage Room-Sink/Faucet

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Report**  
**From 05/19/2024 to 05/25/2024**

From: 5/19/2024  
 To: 5/25/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing

**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
5/20/2024	12:00 AM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.2
5/20/2024	12:01 AM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			3.1
5/20/2024	12:03 AM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:04 AM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:05 AM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:14 AM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.5		
5/20/2024	12:19 AM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:20 AM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:21 AM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:28 AM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:29 AM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:40 AM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:41 AM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:43 AM		6W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:45 AM		6W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	12:53 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
5/20/2024	1:47 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	1:48 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	1:56 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	1:57 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	2:03 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	2:04 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	2:06 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	2:07 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	2:08 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	2:15 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
5/20/2024	3:27 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
5/20/2024	4:13 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	4:13 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	4:14 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	4:22 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	4:22 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	4:22 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	4:23 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
5/20/2024	4:26 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.67	1.6	
5/20/2024	4:29 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	4:29 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	4:36 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	4:36 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	4:38 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.66	1.8	
5/20/2024	4:48 AM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	7:38 PM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	7:38 PM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	7:52 PM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	7:52 PM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	7:52 PM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:00 PM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:01 PM		4M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:10 PM		4W-2 Women's Restroom West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:10 PM		4W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:10 PM		4W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:25 PM		C407 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
5/20/2024	8:30 PM		3W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:30 PM		3W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:32 PM		3W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:35 PM		3M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:35 PM		3M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:58 PM		3M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:58 PM		3W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:58 PM		3W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	8:58 PM		3W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/20/2024	9:00 PM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

5/20/2024	9:10 PM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	9:11 PM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/20/2024	9:11 PM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	9:12 PM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	9:12 PM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	9:20 PM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	9:21 PM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	9:30 PM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	9:30 PM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/20/2024	9:30 PM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	9:39 PM	LLM-1 Men-Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	9:44 PM	10M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	9:45 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	9:48 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	9:49 PM	10M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	9:51 PM	C207 Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
5/20/2024	9:52 PM	10W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/20/2024	9:53 PM	10W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	9:54 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	9:54 PM	LLW-1 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	9:54 PM	LLW-1 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	9:55 PM	LLM-1 Men-Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	9:57 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/20/2024	9:58 PM	10W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	9:59 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	10:11 PM	CLL09-1 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.7		
5/20/2024	10:13 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
5/20/2024	10:18 PM	Suite 1015 GSA Kitchenette Faucet (1000-03)	2	✓	□	1.5	1.4	1.4	
5/20/2024	10:21 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	10:22 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/20/2024	10:23 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	10:31 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	10:32 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	10:40 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	10:41 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	10:43 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	10:44 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/20/2024	10:45 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	11:01 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	11:04 PM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/20/2024	11:05 PM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	11:06 PM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	11:13 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	11:14 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	11:17 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/20/2024	11:18 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	11:19 PM	8W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	11:24 PM	C807-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.7		
5/20/2024	11:45 PM	7W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	11:46 PM	7W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/20/2024	11:47 PM	7W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	11:54 PM	7M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			1.9
5/20/2024	11:55 PM	7M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	7:23 AM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
5/20/2024	1:46 A/M	5W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/20/2024	11:00 M	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/20/2024	12:44 A	6W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/21/2024	8:30 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.3	1.2	
5/21/2024	8:45 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.2	1.2	
5/21/2024	8:50 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5			0.32
5/21/2024	9:00 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.2	1.1	
5/21/2024	9:00 AM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	□	1.5			0.30
5/21/2024	9:15 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.2	1.2	
5/21/2024	9:25 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.2	1.3	
5/21/2024	9:40 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.2	1.2	
5/21/2024	9:55 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.2	1.1	
5/21/2024	10:10 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.2	1.2	
5/21/2024	10:20 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.2	1.3	
5/21/2024	10:25 AM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.2	1.3	
5/21/2024	10:35 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.2	1.2	
5/21/2024	10:50 AM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.3	1.2	
5/21/2024	11:05 AM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.2	1.3	
5/21/2024	11:15 AM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
5/21/2024	11:25 AM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.2	1.2	

5/21/2024	11:38 AM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.2	1.2	
5/21/2024	11:49 AM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.2	1.2	
5/21/2024	12:10 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1.2	1.1	
5/21/2024	12:22 PM	Suite 532 Lactation Room - Faucet	2	✓	□	1.5	1.2	1.2	
5/21/2024	12:34 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.2	1.2	
5/21/2024	1:04 PM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.5	1.8	1.7	
5/21/2024	1:15 PM	540 Faucet (507-26)	2	✓	□	1.5	1.2	1.2	
5/21/2024	1:28 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.2	1.2	
5/21/2024	1:40 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.2	1.2	
5/21/2024	1:53 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.2	1.2	
5/22/2024	8:03 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	□	1.5	1.25	1.25	
5/22/2024	8:15 AM	Suite 415 Kitchenette - Faucet (N)	2	✓	□	1.5	1.66	1.66	
5/22/2024	8:30 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.03	1.07	
5/22/2024	8:31 AM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/22/2024	8:31 AM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/22/2024	8:31 AM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/22/2024	8:42 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.2	1.20	
5/22/2024	9:01 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.03	1.07	
5/22/2024	9:01 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5		0.61	
5/22/2024	9:14 AM	126-03 Women-Shower-1st from L to R	1	✓	✓	2			2.72
5/22/2024	9:25 AM	234 Kitchen Faucet (209-04)	2	✓	□	1.5	1.2	1.25	
5/22/2024	9:25 AM	126-03 Women-Shower-2nd from L to R	1	✓	□	2			2.5
5/22/2024	9:25 AM	126-03 Women-Shower-3rd from L to R	1	✓	□	2			2.5
5/22/2024	9:25 AM	126-03 Women-Shower-4th from L to R	1	✓	□	2			3.00
5/22/2024	9:45 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	□	1.5	1.30	1.25	
5/22/2024	9:48 AM	126-05 Men-Lavatory Faucet-Left	2	✓	□	0.5			0.48
5/22/2024	9:48 AM	126-05 Men-Lavatory Faucet-Center	2	✓	□	0.5			0.48
5/22/2024	9:48 AM	126-05 Men-Lavatory Faucet-Right	2	✓	□	0.5			
5/22/2024	10:05 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	□	1.5	1.30	1.25	
5/22/2024	10:24 AM	126-06 Shower Room - Shower-North-Left	1	✓	✓	2			2.3
5/22/2024	10:24 AM	126-06 Shower Room-Shower-North-Center	1	✓	✓	2			2.5
5/22/2024	10:25 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	□	1.5	1.15	1.20	
5/22/2024	10:35 AM	126-06 Shower Room - Shower-North-Right	1	✓	✓	2			2.5
5/22/2024	10:35 AM	126-06 Shower Room - Shower-South-Left	1	✓	□	2			2.3
5/22/2024	10:35 AM	126-06 Shower Room-Shower-South-Center	1	✓	□	2			2.30
5/22/2024	10:35 AM	126-06 Shower Room - Shower-South-Right	1	✓	□	2			2.72
5/22/2024	10:40 AM	123-05 Health Unit - Sink/Faucet	2	✓	□	0.5			1.2
5/22/2024	10:59 AM	123-07 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.42
5/22/2024	10:59 AM	123-08 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
5/22/2024	3:24 PM	128-04 Lactation Room D-Sink/Faucet	2	✓	✓	1.5	1.03	1.07	
5/22/2024	3:45 PM	128-02 Lactation Room B-Sink/Faucet	2	✓	□	1.5	1.07	1.11	
5/22/2024	3:58 PM	128-03 Lactation Room C-Sink/Faucet	2	✓	□	1.5	1.03	1.11	
5/22/2024	4:10 PM	128-01 Lactation Room A-Sink/Faucet	2	✓	□	1.5	1.15	1.11	
5/22/2024	4:39 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	1.30	0.9	
5/22/2024	4:39 PM	Print, Postal Sorting Area Faucet	2	✓	□		2.00	1.66	
5/22/2024	5:05 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
5/22/2024	5:20 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
5/22/2024	5:35 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	□	1.5	1.57	1.66	
5/22/2024	5:50 PM	GSA Suite Kitchenette-Sink/Faucet	2	✓	✓	1.5	0.66	1.25	
5/22/2024	9:08 PM	119-02 Mailroom - Faucet	2	✓	□		1.2	1.57	
5/22/2024	9:16 PM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6			
5/22/2024	9:16 PM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6			
5/22/2024	9:16 PM	119-08 Toilet/Sink Combo-Right	2	✓	□	1.6			
5/22/2024	9:16 PM	119-10 Toilet/Sink Combo	2	✓	□	1.6			
5/22/2024	9:16 PM	119-07 Toilet/Sink Combo-Right	2	✓	□	1.6			
5/22/2024	9:16 PM	119-11 Toilet/Sink Combo	2	✓	□	1.6			
5/22/2024	9:16 PM	119-16A Shower	2	✓	□				1.07
5/22/2024	9:16 PM	119-17 Toilet/Sink Combo	2	✓	□	1.6			
5/22/2024	9:16 PM	119-21 Faucet/Eyewash	2	✓	□		1.11	1.42	

**985 Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 05/19/2024 to 05/25/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
5/21/2024	2944419	Suite. 540 Kitchenette - Faucet
5/22/2024	2944089	119-19 Food Storage Room-Sink/Faucet

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 05/26/2024 to 06/01/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
5/27/2024	2:41 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	2:41 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	2:50 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	2:50 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	2:50 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	2:57 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:00 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:06 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:06 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:06 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:28 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
5/27/2024	10:00 AM		C407 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.5		
5/27/2024	10:23 AM		4M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	10:23 AM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	10:35 AM		4W-2 Women West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	10:35 AM		4W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	10:35 AM		4W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	11:12 AM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.42
5/27/2024	11:12 AM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.42
5/27/2024	11:23 AM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.3
5/27/2024	11:23 AM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.72
5/27/2024	11:23 AM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.5
5/27/2024	11:52 AM		3W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	11:52 AM		3W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	11:52 AM		3W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	12:24 PM		3M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	12:24 PM		3M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	12:35 PM		3M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	12:50 PM		3W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	12:50 PM		3W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	12:50 PM		3W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	1:15 PM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	2:15 PM		2M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	2:15 PM		2M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	2:30 PM		2W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	2:30 PM		2W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	2:30 PM		2W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:00 PM		2M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:00 PM		2M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:00 PM		C207 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
5/27/2024	3:15 PM		2W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:15 PM		2W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:15 PM		2W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:31 PM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:31 PM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		3.75		
5/27/2024	3:47 PM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		3.75		
5/27/2024	3:58 PM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	3:58 PM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	4:10 PM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	4:10 PM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	4:21 PM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	4:21 PM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	4:21 PM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	4:31 PM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	4:31 PM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	4:31 PM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	4:45 PM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.07	1.07	
5/27/2024	4:45 PM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	0.25	0.25	
5/27/2024	5:00 PM		CLL09-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.2		
5/27/2024	5:12 PM		LLM-1 Men-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	5:12 PM		LLM-1 Men-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	5:26 PM		LLW-1 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	5:26 PM		LLW-1 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/27/2024	7:50 PM		10W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

5/27/2024	7:51 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/27/2024	7:51 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	7:54 PM	10M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	7:54 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	7:58 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	7:59 PM	10M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	8:01 PM	10W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/27/2024	8:01 PM	10W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	8:01 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	8:03 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
5/27/2024	8:08 PM	7M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	8:08 PM	7M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	8:09 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	8:10 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	8:10 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/27/2024	8:13 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	8:13 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	8:21 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	8:23 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	8:23 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	8:23 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/27/2024	8:23 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	8:27 PM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.8		
5/27/2024	8:36 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	8:36 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	8:50 PM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/27/2024	8:51 PM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	8:53 PM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	8:57 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	8:57 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	9:00 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/27/2024	9:00 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	9:00 PM	8W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	9:00 PM	C807-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.8		
5/27/2024	9:05 PM	7W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	9:05 PM	7W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/27/2024	9:05 PM	7W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	9:12 PM	7M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			2.00
5/27/2024	9:14 PM	7M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	✓	0.5			2.100
5/27/2024	9:17 PM	7W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	9:17 PM	7W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/27/2024	9:17 PM	7W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	9:19 PM	C707-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.8		
5/27/2024	9:23 PM	6W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	9:23 PM	6W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/27/2024	9:24 PM	6M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	9:24 PM	6M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	9:29 PM	6M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	9:31 PM	6M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	9:32 PM	6W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
5/27/2024	9:32 PM	6W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
5/27/2024	9:32 PM	6W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
5/27/2024	9:36 PM	C607-Janitor's Closet - Mop/Slop Sink	1	✓	□		1.8		
5/27/2024	9:58 PM	Suite 1015 GSA Kitchenette Faucet (1000-03)	2	✓	□	1.5	1.2	1.21	
5/28/2024	1:43 PM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.3	1.25	
5/28/2024	1:55 PM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.3	1.25	
5/28/2024	2:08 PM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.2	1.2	
5/28/2024	2:21 PM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.15	1.2	
5/28/2024	2:31 PM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.07	1.11	
5/28/2024	2:47 PM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.36	1.25	
5/28/2024	3:03 PM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.2	1.15	
5/28/2024	3:14 PM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.3	1.15	
5/28/2024	3:25 PM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.36	1.3	
5/28/2024	3:52 PM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.42	1.36	
5/28/2024	4:06 PM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.36	1.3	
5/28/2024	4:06 PM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5		0.29	
5/28/2024	4:29 PM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.30	1.25	
5/28/2024	4:40 PM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
5/28/2024	4:53 PM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.3	1.3	
5/28/2024	5:03 PM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.2	1.2	
5/29/2024	10:10 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.2	1.2	
5/29/2024	10:15 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5		1.2	
5/29/2024	10:55 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.2	1.2	
5/29/2024	11:05 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.3	1.2	

5/29/2024	11:15 AM	Suite 410 Kitchenette Faucet (NW)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
5/29/2024	11:25 AM	234 Kitchen Faucet (209-04)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.2	
5/29/2024	11:35 AM	Break Room North West - Kitchen Faucet (207-14)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.2	
5/29/2024	11:45 AM	Break Room North East Kitchen - Faucet (207-39)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
5/29/2024	12:00 PM	Break Room South East Kitchen - Faucet (207-49)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
5/29/2024	1:10 PM	123-05 Health Unit - Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.2
5/29/2024	1:15 PM	123-07 Health Unit-Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/29/2024	1:20 PM	123-08 Health Unit-Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/29/2024	1:30 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	2.0	2.1	
5/29/2024	1:40 PM	GSA Suite Kitchenette-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
5/29/2024	2:05 PM	128-01 Lactation Room A-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.3	
5/29/2024	2:10 PM	128-02 Lactation Room B-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
5/29/2024	2:15 PM	128-03 Lactation Room C-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.1	1.2	
5/29/2024	2:30 PM	128-04 Lactation Room D-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.2	
5/29/2024	3:00 PM	LL15 Men's Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/29/2024	3:10 PM	LL15 Women's Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/29/2024	3:15 PM	LL15 Break Room-Kitchen Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.1	
5/29/2024	3:30 PM	Print, Postal Sorting Area Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.1	2.2	
5/29/2024	6:20 PM	126-02 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/29/2024	6:25 PM	126-02 Women-Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/29/2024	6:30 PM	126-02 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/29/2024	6:38 PM	126-03 Women-Shower-1st from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.3
5/29/2024	6:40 PM	126-03 Women-Shower-2nd from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.3
5/29/2024	6:45 PM	126-03 Women-Shower-3rd from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.4
5/29/2024	6:47 PM	126-03 Women-Shower-4th from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.3
5/29/2024	6:50 PM	126-05 Men-Lavatory Faucet-Left	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/29/2024	6:55 PM	126-05 Men-Lavatory Faucet-Center	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
5/29/2024	7:10 PM	126-06 Shower Room - Shower-North-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.4
5/29/2024	7:15 PM	126-06 Shower Room-Shower-North-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.3
5/29/2024	7:18 PM	126-06 Shower Room - Shower-North-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.5
5/29/2024	7:20 PM	126-06 Shower Room - Shower-South-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.3
5/29/2024	7:22 PM	126-06 Shower Room-Shower-South-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.4
5/29/2024	7:30 PM	126-06 Shower Room - Shower-South-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.2
5/29/2024	11:19 PM	119-02 Mailroom - Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.57	1.11	
5/29/2024	11:19 PM	119-07 Toilet/Sink Combo-Left	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
5/29/2024	11:19 PM	119-08 Toilet/Sink Combo-Left	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
5/29/2024	11:19 PM	119-08 Toilet/Sink Combo-Right	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
5/29/2024	11:19 PM	119-10 Toilet/Sink Combo	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
5/29/2024	11:19 PM	119-07 Toilet/Sink Combo-Right	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
5/29/2024	11:19 PM	119-11 Toilet/Sink Combo	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
5/29/2024	11:19 PM	119-16A Shower	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.2	1.42	1.3
5/29/2024	11:19 PM	119-17 Toilet/Sink Combo	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
5/29/2024	11:19 PM	119-21 Faucet/Eyewash	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.2	1.42	

**985 Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 05/26/2024 to 06/01/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
5/27/2024	2944287	6W-1 Women's Restroom East - Lavatory Faucet-Left
5/28/2024	2944419	Suite. 540 Kitchenette - Faucet
5/28/2024	2945147	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)
5/28/2024	2944226	Suite 540 Kitchenette - Faucet (507-25)
5/28/2024	2945142	540 Faucet (507-26) A (Second fixture)
5/28/2024	2944278	Suite 615 Break Room-Kitchen Faucet (607-06)
5/28/2024	2945143	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)
5/28/2024	2944260	Suite 520 Kitchenette Faucet (508-13)
5/28/2024	2944259	Suite 530 Kitchenette - Faucet (509-10)
5/28/2024	2944418	Suite 532 Lactation Room - Faucet
5/28/2024	2944227	Suite 535 Break Room-Kitchen Faucet (507-36)
5/28/2024	2944228	540 Faucet (507-26)
5/28/2024	2944247	Suite 540 Training Lobby - Faucet (507-12)
5/29/2024	2944222	Suite 415 Kitchenette - Faucet (N)
5/29/2024	2944089	119-19 Food Storage Room-Sink/Faucet
5/29/2024	2944116	126-05 Men-Lavatory Faucet-Right

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 06/02/2024 to 06/08/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
6/3/2024	12:00 AM		8W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	12:22 AM		C807-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.1		
6/3/2024	12:30 AM		7W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	12:33 AM		7W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	12:35 AM		7W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	1:10 AM		7M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	2:00 AM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	2:15 AM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			2
6/3/2024	2:20 AM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			2.1
6/3/2024	2:25 AM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	2:30 AM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	2:35 AM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	2:50 AM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.4		
6/3/2024	3:05 AM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	3:10 AM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	3:45 AM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	3:50 AM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:02 AM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:04 AM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.65
6/3/2024	4:08 AM		6W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.45
6/3/2024	4:10 AM		6W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:10 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:10 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.2		
6/3/2024	4:15 AM		6W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:17 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.6		
6/3/2024	4:23 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:23 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:23 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:27 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:28 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:28 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:36 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	70	124	
6/3/2024	4:36 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	70	123	
6/3/2024	4:54 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	4:55 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.5		
6/3/2024	4:55 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	5:15 AM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	9:27 AM		LLM-1 Men-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	7:35 PM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	7:35 PM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	7:47 PM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	7:47 PM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	7:48 PM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	7:51 PM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	7:54 PM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.5		
6/3/2024	7:56 PM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	7:58 PM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	7:58 PM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	7:58 PM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:02 PM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:03 PM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:10 PM		C1007-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		1.00		
6/3/2024	8:11 PM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:11 PM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:12 PM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:14 PM		4W-2 Women West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:14 PM		4W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:15 PM		4W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:17 PM		10M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:21 PM		4M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:22 PM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:23 PM		C407 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
6/3/2024	8:25 PM		10W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/3/2024	8:30 PM		10W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

6/3/2024	8:32 PM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	8:32 PM	3W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/3/2024	8:32 PM	3W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	8:33 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	8:36 PM	3M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	8:36 PM	3M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	8:46 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	8:48 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	8:48 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/3/2024	8:48 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	8:54 PM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	8:55 PM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	8:55 PM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	8:55 PM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	8:55 PM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/3/2024	9:00 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/3/2024	9:01 PM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	9:01 PM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	9:04 PM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	9:04 PM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/3/2024	9:04 PM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	9:05 PM	10W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	9:05 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	9:10 PM	10M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	9:10 PM	C207 Janitor's Closet-Mop/Slop Sink	1	✓	□				
6/3/2024	9:12 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	9:30 PM	Suite 1015 GSA Kitchenette Faucet (1000-03)	2	✓	□	1.5	1.2	1.2	
6/3/2024	9:33 PM	LLM-1 Men-Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	9:33 PM	LLW-1 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	9:33 PM	LLW-1 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	9:38 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	9:40 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/3/2024	9:41 PM	CLL09-1 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.7		
6/3/2024	10:10 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	10:15 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	10:20 PM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.2		
6/3/2024	10:22 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	10:24 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	10:28 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	10:30 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/3/2024	10:35 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	11:05 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	11:08 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	11:15 PM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/3/2024	11:18 PM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	11:20 PM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	11:40 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	11:54 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/3/2024	11:58 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	11:35 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	3:00 M	6W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	4:48 AM	1M-2 Men's Restroom South - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/3/2024	4:48 AM	1M-2 Men's Restroom South - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	9:44 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/3/2024	PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/4/2024	8:15 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.2	1.2	
6/4/2024	8:15 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.3	1.3	
6/4/2024	8:16 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5		0.32	
6/4/2024	8:30 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.2	1.3	
6/4/2024	8:32 AM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	□	1.5		0.3	
6/4/2024	8:55 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.2	1.3	
6/4/2024	9:05 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.3	1.2	
6/4/2024	9:25 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5			
6/4/2024	9:25 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.2	1.2	
6/4/2024	9:35 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.2	1.2	
6/4/2024	9:46 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.2	1.2	
6/4/2024	10:02 AM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.3	1.2	
6/4/2024	10:15 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.3	1.2	
6/4/2024	10:25 AM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.2	1.2	
6/4/2024	11:25 AM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.3	1.3	
6/4/2024	11:35 AM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
6/4/2024	11:45 AM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.3	1.3	
6/4/2024	11:55 AM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.3	1.3	
6/4/2024	12:10 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1.2	1.2	

6/4/2024	12:20 PM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.2	1.2	
6/4/2024	12:30 PM	Suite 532 Lactation Room - Faucet	2	✓	□	1.5	1.2	1.3	
6/4/2024	12:45 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.2	1.1	
6/4/2024	1:00 PM	540 Faucet (507-26)	2	✓	□	1.5	1.2	1.2	
6/4/2024	1:15 PM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.5	1.4	1.3	
6/4/2024	1:30 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.2	1.2	
6/4/2024	1:40 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.3	1.2	
6/4/2024	1:45 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.2	1.3	
6/5/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.2	1.1	
6/5/2024	8:35 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5			0.32
6/5/2024	8:45 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.2	1.3	
6/5/2024	9:00 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.2	1.1	
6/5/2024	9:15 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	□	1.5	1.2	1.2	
6/5/2024	9:30 AM	234 Kitchen Faucet (209-04)	2	✓	□	1.5	1.2	1.2	
6/5/2024	9:30 AM	119-02 Mailroom - Faucet	2	✓	□		1.8	1.8	
6/5/2024	9:45 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	□	1.5	1.2	1.2	
6/5/2024	9:45 AM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6			
6/5/2024	9:55 AM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6			
6/5/2024	10:00 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	✓	1.5	1.2	1.2	
6/5/2024	10:09 AM	119-08 Toilet/Sink Combo-Right	2	✓	□	1.6			
6/5/2024	10:15 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	✓	1.5	1.2	1.2	
6/5/2024	10:21 AM	119-10 Toilet/Sink Combo	2	✓	□	1.6			
6/5/2024	10:30 AM	123-05 Health Unit - Sink/Faucet	2	✓	□	0.5			1.2
6/5/2024	10:33 AM	119-07 Toilet/Sink Combo-Right	2	✓	□	1.6			
6/5/2024	10:45 AM	123-08 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
6/5/2024	10:46 AM	119-11 Toilet/Sink Combo	2	✓	□	1.6			
6/5/2024	11:00 AM	GSA Suite Kitchenette-Sink/Faucet	2	✓	□	1.5	1.2	1.2	
6/5/2024	11:15 AM	128-01 Lactation Room A-Sink/Faucet	2	✓	□	1.5	1.2	1.3	
6/5/2024	11:18 AM	128-02 Lactation Room B-Sink/Faucet	2	✓	□	1.5	1.2	1.1	
6/5/2024	11:19 AM	119-17 Toilet/Sink Combo	2	✓	□	1.6			
6/5/2024	11:20 AM	128-03 Lactation Room C-Sink/Faucet	2	✓	□	1.5	1.2	1.2	
6/5/2024	11:25 AM	128-04 Lactation Room D-Sink/Faucet	2	✓	□	1.5	1.2	1.2	
6/5/2024	12:06 PM	119-21 Faucet/Eyewash	2	✓	□		1.2	1.2	
6/5/2024	1:05 PM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/5/2024	1:08 PM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/5/2024	1:10 PM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/5/2024	1:15 PM	126-03 Women-Shower-1st from L to R	1	✓	□	2			2.8
6/5/2024	1:18 PM	126-03 Women-Shower-2nd from L to R	1	✓	□	2			2.7
6/5/2024	1:20 PM	126-03 Women-Shower-3rd from L to R	1	✓	□	2			2.9
6/5/2024	1:22 PM	126-03 Women-Shower-4th from L to R	1	✓	□	2			3
6/5/2024	1:30 PM	126-05 Men-Lavatory Faucet-Left	2	✓	□	0.5			0.48
6/5/2024	1:33 PM	126-05 Men-Lavatory Faucet-Center	2	✓	□	0.5			0.48
6/5/2024	1:35 PM	123-07 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
6/5/2024	1:35 PM	126-05 Men-Lavatory Faucet-Right	2	✓	□	0.5			0.48
6/5/2024	1:46 PM	126-06 Shower Room - Shower-North-Left	1	✓	□	2			2.9
6/5/2024	1:48 PM	126-06 Shower Room-Shower-North-Center	1	✓	□	2			3
6/5/2024	1:50 PM	126-06 Shower Room - Shower-North-Right	1	✓	□	2			2.4
6/5/2024	1:55 PM	126-06 Shower Room - Shower-South-Left	1	✓	□	2			2.2
6/5/2024	2:00 PM	126-06 Shower Room-Shower-South-Center	1	✓	□	2			2.4
6/5/2024	2:05 PM	126-06 Shower Room - Shower-South-Right	1	✓	□	2			2.3
6/5/2024	2:20 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
6/5/2024	2:30 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
6/5/2024	2:40 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	1.1	1.1	
6/5/2024	2:45 PM	Print, Postal Sorting Area Faucet	2	✓	□		2.0	2.0	
6/5/2024	11:01 AM	119-16A Shower	2	✓	□				1.9

**985 Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 06/02/2024 to 06/08/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
6/4/2024	2944419	Suite. 540 Kitchenette - Faucet
6/5/2024	2944222	Suite 415 Kitchenette - Faucet (N)
6/5/2024	2944106	113-6 JLL Kitchenette-Kitchen Faucet
6/5/2024	2944089	119-19 Food Storage Room-Sink/Faucet

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 06/09/2024 to 06/15/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
6/10/2024	2:28 AM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	2:28 AM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	2:49 AM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.5		
6/10/2024	2:49 AM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	2:49 AM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	2:49 AM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:02 AM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:02 AM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:07 AM		6W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:07 AM		6W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:07 AM		6W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:11 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
6/10/2024	3:14 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:14 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:14 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:16 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:16 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:21 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:21 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:24 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:24 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:24 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	3:25 AM		C407 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		0.48		
6/10/2024	3:26 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.4		
6/10/2024	4:00 AM		4M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:00 AM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:10 AM		4W-2 Women West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:10 AM		4W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:10 AM		4W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:25 AM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:25 AM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:37 AM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:37 AM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:37 AM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:50 AM		3W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:50 AM		3W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	4:50 AM		3W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	5:05 AM		3M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	5:05 AM		3M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	5:15 AM		3M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	5:27 AM		3W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	5:27 AM		3W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	5:27 AM		3W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	5:40 AM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	5:50 AM		2M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	5:50 AM		2M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:05 AM		2W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:05 AM		2W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:05 AM		2W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:15 AM		2M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:15 AM		2M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:20 AM		2W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:20 AM		2W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:20 AM		2W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:25 AM		C207 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
6/10/2024	6:30 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:30 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
6/10/2024	6:37 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
6/10/2024	6:40 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:40 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:45 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:45 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:45 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/10/2024	6:55 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

6/10/2024	6:55 AM	1M-2 Men's Restroom South - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	6:55 AM	1M-1 Men's Restroom North - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	6:55 AM	1M-1 Men's Restroom North - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/10/2024	6:55 AM	1M-1 Men's Restroom North - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	7:00 AM	108-4 Cafe Prep. - Kitchen Faucet-Small	1	✓	□	1.5	0.75	1.22	
6/10/2024	7:00 AM	108-4 Cafe Prep. - Kitchen Faucet-Large	1	✓	□	1.5	0.75	1.20	
6/10/2024	7:12 AM	CLL09-1 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.75		
6/10/2024	7:12 AM	LLM-1 Men-Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	7:12 AM	LLM-1 Men-Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	7:20 AM	LLW-1 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	7:25 AM	LLW-1 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	8:24 PM	10M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	8:24 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	8:30 PM	10W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	8:31 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/10/2024	8:31 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	8:31 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/10/2024	8:32 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	8:32 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	8:33 PM	Suite 1015 GSA Kitchenette Faucet (1000-03)	2	✓	□	1.5	0.9	1.23	
6/10/2024	8:37 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	8:38 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	8:39 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	8:39 PM	10M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	8:39 PM	10W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/10/2024	8:39 PM	10W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	8:39 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	8:51 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	8:58 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	9:00 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	9:00 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/10/2024	9:00 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	9:07 PM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
6/10/2024	9:12 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	9:12 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	9:14 PM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/10/2024	9:14 PM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	9:15 PM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	9:18 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	9:19 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	9:19 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/10/2024	9:19 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	9:22 PM	8W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	9:24 PM	C807-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.5		
6/10/2024	9:27 PM	7W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	9:27 PM	7W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/10/2024	9:27 PM	7W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	9:29 PM	7M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	9:29 PM	7M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	9:32 PM	7M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	9:32 PM	7M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	9:32 PM	7W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/10/2024	9:32 PM	7W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/10/2024	9:32 PM	7W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/10/2024	9:46 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.7		
6/11/2024	8:19 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.11	1.15	
6/11/2024	8:46 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.25	1.25	
6/11/2024	9:00 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.36	1.36	
6/11/2024	9:00 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5			0.78
6/11/2024	9:33 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.36	1.42	
6/11/2024	9:57 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.25	1.2	
6/11/2024	10:15 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.03	1.11	
6/11/2024	10:59 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.3	1.36	
6/11/2024	11:32 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.11	1.07	
6/11/2024	11:44 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.15	1.11	
6/11/2024	2:21 PM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.2	1.2	
6/11/2024	2:34 PM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.15	1.11	
6/11/2024	2:46 PM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.2	1.25	
6/11/2024	2:59 PM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.42	1.2	
6/11/2024	3:10 PM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.2	1.2	
6/11/2024	3:24 PM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.2	1.2	
6/11/2024	3:35 PM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
6/11/2024	3:45 PM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.11	1.11	

6/11/2024	3:57 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	☐	1.5	1.03	1.03	
6/11/2024	4:11 PM	540 Faucet (507-26) A (Second fixture)	2	✓	☐	1.5	1.25	1.2	
6/11/2024	4:20 PM	540 Faucet (507-26)	2	✓	☐	1.5	1.07	1.03	
6/11/2024	4:31 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	☐	1.5	1.2	1.2	
6/11/2024	4:42 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	☐	1.5	1.11	1.11	
6/11/2024	4:55 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	☐	1.5	1.2	1.15	
6/11/2024	5:11 PM	Suite 532 Lactation Room - Faucet	2	✓	☐	1.5	1.20	1.20	
6/11/2024	5:22 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	☑	1.5	1.15	1.07	
6/12/2024	1:58 AM	119-16A Shower	2	✓	☐				2.3
6/12/2024	2:13 AM	119-21 Faucet/Eyewash	2	✓	☐		1.8	1.8	
6/12/2024	2:48 AM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	☐	1.5	1.8	1.8	
6/12/2024	8:11 AM	119-19 Food Storage Room-Sink/Faucet	2	✓	☐	1.6	0.76	0.84	
6/12/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	☐	1.5	1.2	1.2	
6/12/2024	8:35 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	☐	1.5			1.3
6/12/2024	8:50 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	☐	1.5	1.3	1.2	
6/12/2024	9:00 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	☐	1.5	1.3	1.2	
6/12/2024	9:10 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	☐	1.5	1.2	1.2	
6/12/2024	9:21 AM	234 Kitchen Faucet (209-04)	2	✓	☑	1.5	1.2	1.3	
6/12/2024	9:32 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	☑	1.5	1.1	1.3	
6/12/2024	9:40 AM	119-02 Mailroom - Faucet	2	✓	☐		1.8	1.8	
6/12/2024	9:43 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	☐	1.5	1.2	1.3	
6/12/2024	9:54 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	☐	1.5	1.3	1.3	
6/12/2024	11:08 AM	LL15 Women's Restroom - Lavatory Faucet	1	✓	☐	0.5			0.32
6/12/2024	11:20 AM	LL15 Break Room-Kitchen Faucet	2	✓	☐	1.5	1.2	1.1	
6/12/2024	11:30 AM	Print, Postal Sorting Area Faucet	2	✓	☑		1.4	1.4	
6/12/2024	3:00 PM	GSA Suite Kitchenette-Sink/Faucet	2	✓	☐	1.5	1.4	1.4	
6/12/2024	9:28 PM	126-05 Men-Lavatory Faucet-Center	2	✓	☐	0.5			0.48
6/12/2024	9:28 PM	126-05 Men-Lavatory Faucet-Right	2	✓	☐	0.5			0.48
6/12/2024	9:40 PM	126-06 Shower Room - Shower-North-Left	1	✓	☐	2			4.64
6/12/2024	9:46 PM	126-06 Shower Room-Shower-North-Center	1	✓	☐	2			2.12
6/12/2024	9:51 PM	126-06 Shower Room - Shower-North-Right	1	✓	☐	2			2.08
6/12/2024	9:54 PM	126-06 Shower Room - Shower-South-Left	1	✓	☐	2			2.16
6/12/2024	9:56 PM	126-06 Shower Room-Shower-South-Center	1	✓	☐	2			2.32
6/12/2024	10:00 PM	123-05 Health Unit - Sink/Faucet	2	✓	☐	0.5			1.3
6/12/2024	10:01 PM	126-06 Shower Room - Shower-South-Right	1	✓	☐	2			2.32
6/12/2024	10:04 PM	123-07 Health Unit-Lavatory Faucet	2	✓	☐	0.5			0.48
6/12/2024	10:06 PM	126-05 Men-Lavatory Faucet-Left	2	✓	☐	0.5			0.48
6/12/2024	10:10 PM	123-08 Health Unit-Lavatory Faucet	2	✓	☐	0.5			0.48
6/12/2024	10:20 PM	126-03 Women-Shower-2nd from L to R	1	✓	☐	2			4.6
6/12/2024	10:23 PM	126-03 Women-Shower-1st from L to R	1	✓	☐	2			1.28
6/12/2024	10:25 PM	126-02 Women-Lavatory Faucet-Right	1	✓	☐	0.5			0.48
6/12/2024	10:30 PM	128-01 Lactation Room A-Sink/Faucet	2	✓	☐	1.5	1.2	1.3	
6/12/2024	10:31 PM	126-03 Women-Shower-3rd from L to R	1	✓	☐	2			1.96
6/12/2024	10:31 PM	126-03 Women-Shower-4th from L to R	1	✓	☐	2			1.76
6/12/2024	10:33 PM	128-02 Lactation Room B-Sink/Faucet	2	✓	☐	1.5	1.1	1.1	
6/12/2024	10:35 PM	128-03 Lactation Room C-Sink/Faucet	2	✓	☐	1.5	1.2	1.2	
6/12/2024	10:40 PM	128-04 Lactation Room D-Sink/Faucet	2	✓	☐	1.5	1.2	1.2	
6/12/2024	10:48 PM	126-02 Women-Lavatory Faucet-Left	1	✓	☐	0.5			0.48
6/12/2024	10:49 PM	126-02 Women-Lavatory Faucet-Center	1	✓	☐	0.5			0.48
6/12/2024	11:05 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	☐	0.5			0.48

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 06/09/2024 to 06/15/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
6/11/2024	2944419	Suite. 540 Kitchenette - Faucet
6/12/2024	2944222	Suite 415 Kitchenette - Faucet (N)
6/12/2024	2944092	119-07 Toilet/Sink Combo-Left
6/12/2024	2944094	119-08 Toilet/Sink Combo-Left
6/12/2024	2944095	119-08 Toilet/Sink Combo-Right
6/12/2024	2944091	119-10 Toilet/Sink Combo
6/12/2024	2944093	119-07 Toilet/Sink Combo-Right
6/12/2024	2944090	119-11 Toilet/Sink Combo
6/12/2024	2944088	119-17 Toilet/Sink Combo

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 06/16/2024 to 06/22/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
6/17/2024	3:34 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	3:34 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	3:40 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
6/17/2024	3:53 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	3:53 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	4:00 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
6/17/2024	4:12 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	4:27 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	4:27 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	4:27 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	4:37 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	4:38 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	4:38 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	4:40 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.65	1.18	
6/17/2024	4:40 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.66	1.19	
6/17/2024	5:18 AM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.7
6/17/2024	8:30 AM		10M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	8:48 AM		10M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	9:20 AM		10M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	9:20 AM		10M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	9:30 AM		10W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	9:30 AM		10W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	9:30 AM		10W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	10:00 AM		10W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	10:00 AM		10W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	10:00 AM		10W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	10:25 AM		C1007-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.3		
6/17/2024	10:35 AM		Suite 1015 GSA Kitchenette Faucet (1000-03)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.15	1.11	
6/17/2024	10:49 AM		9W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	10:49 AM		9W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	10:49 AM		9W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	11:12 AM		9M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	11:12 AM		9M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	11:24 AM		9M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	11:24 AM		9M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	11:37 AM		9W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	11:37 AM		9W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	11:37 AM		9W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	11:50 AM		C907-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.72		
6/17/2024	12:00 PM		8M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	12:00 PM		8W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	12:14 PM		8W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	12:14 PM		8W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	12:26 PM		8M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	12:39 PM		8M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	12:39 PM		8M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	12:39 PM		8W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	12:53 PM		8W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	12:53 PM		8W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	1:05 PM		C807-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.5		
6/17/2024	1:15 PM		7W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	1:15 PM		7W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	1:15 PM		7W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	1:35 PM		7M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	1:35 PM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	1:47 PM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.00
6/17/2024	1:47 PM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			2.72
6/17/2024	1:58 PM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	1:58 PM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	1:58 PM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	2:10 PM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.14		
6/17/2024	2:20 PM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	2:20 PM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/17/2024	2:20 PM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

6/17/2024	2:31 PM	6M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	2:31 PM	6M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	2:45 PM	6M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	2:45 PM	6M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	2:58 PM	6W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	2:58 PM	6W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/17/2024	2:58 PM	6W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	3:10 PM	C607-Janitor's Closet - Mop/Slop Sink	1	✓	□		3.33		
6/17/2024	3:22 PM	5W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	3:22 PM	5W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/17/2024	3:22 PM	5W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	3:45 PM	5M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	3:45 PM	5M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	4:10 PM	5M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	4:10 PM	5M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.42
6/17/2024	4:23 PM	5W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	4:23 PM	5W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/17/2024	4:23 PM	5W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.42
6/17/2024	4:46 PM	C507 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.11		
6/17/2024	8:18 PM	4M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	8:19 PM	4M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	8:36 PM	4W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	8:36 PM	4W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/17/2024	8:36 PM	4W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	8:48 PM	C407 Janitor's Closet-Mop/Slop Sink	1	✓	□		1.5		
6/17/2024	8:55 PM	4M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	8:56 PM	4M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	8:56 PM	4W-2 Women West-Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	8:56 PM	4W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/17/2024	8:56 PM	4W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	9:05 PM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	9:05 PM	3W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/17/2024	9:05 PM	3W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	9:10 PM	3M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	9:10 PM	3M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	9:18 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	9:18 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	9:18 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/17/2024	9:18 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	9:26 PM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	9:26 PM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/17/2024	9:26 PM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.46
6/17/2024	9:28 PM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	9:28 PM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	9:35 PM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	9:35 PM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	9:39 PM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	9:39 PM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/17/2024	9:39 PM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	9:44 PM	C207 Janitor's Closet-Mop/Slop Sink	1	✓	□				
6/17/2024	9:46 PM	LLM-1 Men-Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	9:54 PM	CLL09-1 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.6		
6/17/2024	10:06 PM	LLW-1 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/17/2024	10:08 PM	LLM-1 Men-Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/17/2024	10:08 PM	LLW-1 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/18/2024	8:45 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	✓	1.5	1.20	1.30	
6/18/2024	8:46 AM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	□	1.5		0.30	
6/18/2024	9:00 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.20	1.20	
6/18/2024	9:02 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5		0.32	
6/18/2024	9:15 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.2	1.2	
6/18/2024	9:30 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.3	1.2	
6/18/2024	9:45 AM	Suite 707-10 Faucet (707-07)	2	✓	✓	1.5	1.2	1.3	
6/18/2024	9:55 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	✓	1.5	1.2	1.3	
6/18/2024	10:05 AM	Suite 710 Faucet (710-03)	2	✓	✓	1.5	1.2	1.3	
6/18/2024	10:25 AM	Suite 808A Break Room Faucet (809-02)	1	✓	✓	1.5			
6/18/2024	10:25 AM	Suite 810 Kitchen Faucet	1	✓	✓	1.5	1.2	1.2	
6/18/2024	10:35 AM	Suite 907A Break Room Faucet (907-22)	2	✓	✓	1.5	1.2	1.3	
6/18/2024	10:45 AM	Suite 908 Break Room Faucet (908-15)	2	✓	✓	1.5	1.2	1.2	
6/18/2024	10:45 AM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.3	1.3	
6/18/2024	11:00 AM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	✓	1.5	1.2	1.2	
6/18/2024	11:00 AM	Suite 1010 Kitchenette Faucet	2	✓	✓	1.5	1.3	1.3	
6/18/2024	11:20 AM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	✓	1.5	1.2	1.3	
6/18/2024	12:00 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1.1	1.2	
6/18/2024	12:15 PM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	✓	1.5	1.2	1.2	

6/18/2024	1:00 PM	Suite 1010 Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5			0.48
6/18/2024	1:00 PM	Suite 532 Lactation Room - Faucet	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.2	1.3	
6/18/2024	1:15 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
6/18/2024	1:25 PM	540 Faucet (507-26)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
6/18/2024	1:25 PM	Suite 540 Training Lobby - Faucet (507-12)	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.2	1.3	
6/18/2024	1:35 PM	Suite 540 Kitchenette - Faucet (507-25)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
6/18/2024	1:35 PM	540 Faucet (507-26) A (Second fixture)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.4	1.4	
6/18/2024	1:45 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.2	1.3	
6/19/2024	2:03 AM	119-02 Mailroom - Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		0.17	0.17	
6/19/2024	2:03 AM	119-19 Food Storage Room-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6	0.17	0.17	
6/19/2024	2:03 AM	119-21 Faucet/Eyewash	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		0.15	0.15	
6/19/2024	8:12 AM	Suite 415 Kitchenette - Faucet (N)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.76	1.66	
6/19/2024	8:24 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
6/19/2024	8:45 AM	Suite 410 Kitchenette Faucet (NW)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.25	
6/19/2024	9:04 AM	Suite 435 Kitchenette Faucet (SE)	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.03	1.03	
6/19/2024	9:04 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5		0.23	
6/19/2024	9:45 AM	Break Room North West - Kitchen Faucet (207-14)	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.25	1.25	
6/19/2024	10:06 AM	Break Room North East Kitchen - Faucet (207-39)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.30	1.30	
6/19/2024	10:21 AM	Break Room South East Kitchen - Faucet (207-49)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.15	1.07	
6/19/2024	11:07 AM	123-05 Health Unit - Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.15
6/19/2024	11:20 AM	123-07 Health Unit-Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/19/2024	11:20 AM	123-08 Health Unit-Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/19/2024	11:42 AM	128-04 Lactation Room D-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.07	1.11	
6/19/2024	11:52 AM	128-03 Lactation Room C-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.07	1.11	
6/19/2024	12:02 PM	128-02 Lactation Room B-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.15	1.20	
6/19/2024	12:12 PM	128-01 Lactation Room A-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.15	1.15	
6/19/2024	2:41 PM	126-02 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/19/2024	2:41 PM	126-02 Women-Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/19/2024	2:41 PM	126-02 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/19/2024	3:07 PM	126-03 Women-Shower-1st from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.72
6/19/2024	3:20 PM	126-03 Women-Shower-2nd from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.30
6/19/2024	3:20 PM	126-03 Women-Shower-3rd from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.30
6/19/2024	3:20 PM	126-03 Women-Shower-4th from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.50
6/19/2024	3:31 PM	126-05 Men-Lavatory Faucet-Left	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/19/2024	3:41 PM	126-05 Men-Lavatory Faucet-Center	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/19/2024	3:41 PM	126-05 Men-Lavatory Faucet-Right	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/19/2024	3:52 PM	126-06 Shower Room - Shower-North-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.3
6/19/2024	3:52 PM	126-06 Shower Room-Shower-North-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.5
6/19/2024	3:52 PM	126-06 Shower Room - Shower-North-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.14
6/19/2024	4:12 PM	126-06 Shower Room - Shower-South-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.14
6/19/2024	4:12 PM	126-06 Shower Room-Shower-South-Center	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	2			1.85
6/19/2024	4:12 PM	126-06 Shower Room - Shower-South-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.72
6/19/2024	4:50 PM	Print, Postal Sorting Area Faucet	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		2.00	1.66	
6/19/2024	5:12 PM	LL15 Break Room-Kitchen Faucet	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.03	0.93	
6/19/2024	5:31 PM	LL15 Women's Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/19/2024	5:41 PM	LL15 Men's Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/19/2024	6:07 PM	GSA Suite Kitchenette-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.25	1.2	
6/19/2024	6:15 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	2.14	1.76	
				<input type="checkbox"/>	<input type="checkbox"/>				
				<input type="checkbox"/>	<input type="checkbox"/>				

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 06/16/2024 to 06/22/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
6/18/2024	2944419	Suite. 540 Kitchenette - Faucet
6/19/2024	2944223	Suite 416 Kitchenette - Faucet (NE) - North
6/19/2024	2944163	234 Kitchen Faucet (209-04)
6/19/2024	2944092	119-07 Toilet/Sink Combo-Left
6/19/2024	2944094	119-08 Toilet/Sink Combo-Left
6/19/2024	2944095	119-08 Toilet/Sink Combo-Right
6/19/2024	2944091	119-10 Toilet/Sink Combo
6/19/2024	2944093	119-07 Toilet/Sink Combo-Right
6/19/2024	2944090	119-11 Toilet/Sink Combo
6/19/2024	2944087	119-16A Shower
6/19/2024	2944088	119-17 Toilet/Sink Combo

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 06/30/2024 to 07/06/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
7/1/2024	12:10 AM		8W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	12:12 AM		8W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	12:14 AM		8W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	12:44 AM		8M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	12:48 AM		8M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	12:52 AM		8W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	12:54 AM		8W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	12:56 AM		8W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	1:18 AM		C807-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.80		
7/1/2024	1:20 AM		7W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	1:22 AM		7W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	1:24 AM		7W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	1:40 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	1:40 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	1:48 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	1:48 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	1:52 AM		7M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	0.5			2.0
7/1/2024	1:54 AM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:00 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:00 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:05 AM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.0
7/1/2024	2:06 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:07 AM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	0.5			2.0
7/1/2024	2:10 AM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:12 AM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:14 AM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:20 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:21 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:22 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:35 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:47 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
7/1/2024	2:49 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
7/1/2024	2:50 AM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.1		
7/1/2024	2:52 AM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:53 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.68	1.22	
7/1/2024	2:53 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.68	1.20	
7/1/2024	2:54 AM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	2:56 AM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	3:15 AM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	3:24 AM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	3:26 AM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	3:37 AM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	3:40 AM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	3:42 AM		6W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	3:44 AM		6W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	3:46 AM		6W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	4:10 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.5		
7/1/2024	4:15 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	4:18 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	4:20 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	4:55 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	4:57 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	5:10 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		1.7		
7/1/2024	5:25 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	5:30 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	5:34 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	5:36 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	5:37 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	7:59 PM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	7:59 PM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	8:25 PM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	8:25 PM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	8:25 PM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/1/2024	8:35 PM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

7/1/2024	8:36 PM	4M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	8:38 PM	4W-2 Women West-Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	8:38 PM	4W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/1/2024	8:39 PM	4W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	8:41 PM	C407 Janitor's Closet-Mop/Slop Sink	1	✓	□		1.8		
7/1/2024	8:45 PM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			4.0
7/1/2024	8:45 PM	3W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/1/2024	8:45 PM	3W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	8:48 PM	3M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	8:48 PM	3M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	8:50 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	8:53 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	8:53 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/1/2024	8:53 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	8:59 PM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	8:59 PM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	9:00 PM	10M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	9:01 PM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	9:01 PM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/1/2024	9:01 PM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	9:05 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	9:08 PM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	9:09 PM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	9:10 PM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	9:11 PM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/1/2024	9:11 PM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	9:20 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	9:25 PM	10M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	9:40 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/1/2024	9:45 PM	10W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	9:50 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	10:01 PM	LLM-1 Men-Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	10:02 PM	10W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/1/2024	10:04 PM	10W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	10:06 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	10:15 PM	LLM-1 Men-Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	10:16 PM	LLW-1 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	10:16 PM	LLW-1 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	10:22 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	✓		3.6		
7/1/2024	10:28 PM	CLL09-1 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.5		
7/1/2024	10:30 PM	Suite 1015 GSA Kitchenette Faucet (1000-03)	2	✓	✓	1.5	1.3	1.2	
7/1/2024	10:34 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/1/2024	10:35 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	10:36 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	11:02 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	11:04 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	11:12 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	11:14 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	11:16 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/1/2024	11:18 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/1/2024	11:20 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	11:46 PM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
7/1/2024	11:55 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/1/2024	11:58 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/2/2024	8:10 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.3	1.3	
7/2/2024	8:11 AM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	□	1.5	1.2	1.2	
7/2/2024	8:20 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.3	1.3	
7/2/2024	8:40 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.2	1.3	
7/2/2024	8:50 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.2	1.3	
7/2/2024	9:00 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.2	1.2	
7/2/2024	9:10 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.2	1.2	
7/2/2024	9:15 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.2	1.3	
7/2/2024	9:15 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5	1.2	1.2	
7/2/2024	9:25 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.2	1.2	
7/2/2024	9:35 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.3	1.2	
7/2/2024	9:45 AM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.3	1.2	
7/2/2024	10:00 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.2	1.2	
7/2/2024	10:10 AM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.3	1.2	
7/2/2024	10:20 AM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.3	1.3	
7/2/2024	10:30 AM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
7/2/2024	10:40 AM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.3	1.3	
7/2/2024	11:00 AM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.2	1.2	
7/2/2024	11:30 AM	Suite 532 Lactation Room - Faucet	2	✓	□	1.5	1.1	1.3	
7/2/2024	11:40 AM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	✓	1.5	1.2	1.2	

7/2/2024	11:50 AM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	☐	1.5	1.3	1.2	
7/2/2024	1:00 PM	540 Faucet (507-26) A (Second fixture)	2	✓	☐	1.5	1.4	1.4	
7/2/2024	1:00 PM	540 Faucet (507-26)	2	✓	☑	1.5	1.1	1.1	
7/2/2024	1:20 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	☐	1.5	1.2	1.2	
7/2/2024	1:20 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	☐	1.5	1.2	1.2	
7/2/2024	1:30 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	☐	1.5	1.2	1.1	
7/2/2024	2:00 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	☐	1.5	1.2	1.2	
7/3/2024	12:40 AM	119-02 Mailroom - Faucet	2	✓	☐		1.1	1.1	
7/3/2024	12:40 AM	119-07 Toilet/Sink Combo-Left	2	✓	☐	1.6			
7/3/2024	12:40 AM	119-08 Toilet/Sink Combo-Left	2	✓	☐	1.6			
7/3/2024	12:40 AM	119-08 Toilet/Sink Combo-Right	2	✓	☐	1.6			
7/3/2024	12:40 AM	119-10 Toilet/Sink Combo	2	✓	☐	1.6			
7/3/2024	12:40 AM	119-07 Toilet/Sink Combo-Right	2	✓	☐	1.6			
7/3/2024	12:40 AM	119-11 Toilet/Sink Combo	2	✓	☐	1.6			
7/3/2024	12:40 AM	119-16A Shower	2	✓	☐				0.76
7/3/2024	12:40 AM	119-17 Toilet/Sink Combo	2	✓	☐	1.6			
7/3/2024	12:40 AM	119-19 Food Storage Room-Sink/Faucet	2	✓	☐	1.6	1.1	1.1	
7/3/2024	12:40 AM	119-21 Faucet/Eyewash	2	✓	☐		1.0	1.0	
7/3/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	☐	1.5	1.2	1.2	
7/3/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	☐	1.5			0.34
7/3/2024	8:40 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	☐	1.5			
7/3/2024	8:40 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	☑	1.5	1.2	1.3	
7/3/2024	9:20 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	☐	1.5	1.2	1.2	
7/3/2024	9:30 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	☐	1.5	1.3	1.3	
7/3/2024	9:40 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	☐	1.5	1.2	1.2	
7/3/2024	9:48 AM	234 Kitchen Faucet (209-04)	2	✓	☐	1.5	1.2	1.2	
7/3/2024	10:00 AM	128-01 Lactation Room A-Sink/Faucet	2	✓	☐	1.5	1.2	1.2	
7/3/2024	10:05 AM	128-02 Lactation Room B-Sink/Faucet	2	✓	☐	1.5	1.2	1.3	
7/3/2024	10:10 AM	128-03 Lactation Room C-Sink/Faucet	2	✓	☐	1.5	1.3	1.3	
7/3/2024	10:15 AM	128-04 Lactation Room D-Sink/Faucet	2	✓	☐	1.5	1.2	1.2	
7/3/2024	10:30 AM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	☐	1.5	1.5	1.4	
7/3/2024	10:40 AM	GSA Suite Kitchenette-Sink/Faucet	2	✓	☑	1.5	1.3	1.3	
7/3/2024	10:45 AM	126-02 Women-Lavatory Faucet-Right	1	✓	☐	0.5			0.48
7/3/2024	10:50 AM	126-02 Women-Lavatory Faucet-Center	1	✓	☐	0.5			0.48
7/3/2024	10:55 AM	126-02 Women-Lavatory Faucet-Left	1	✓	☐	0.5			0.48
7/3/2024	11:00 AM	123-05 Health Unit - Sink/Faucet	2	✓	☐	0.5			1.2
7/3/2024	11:05 AM	123-07 Health Unit-Lavatory Faucet	2	✓	☐	0.5			0.48
7/3/2024	11:10 AM	Suite 415 Kitchenette - Faucet (N)	2	✓	☑	1.5	3.0	3.0	
7/3/2024	11:15 AM	123-08 Health Unit-Lavatory Faucet	2	✓	☐	0.5			0.48
7/3/2024	11:15 AM	126-05 Men-Lavatory Faucet-Center	2	✓	☐	0.5			0.48
7/3/2024	11:20 AM	126-05 Men-Lavatory Faucet-Left	2	✓	☐	0.5			0.48
7/3/2024	11:25 AM	126-05 Men-Lavatory Faucet-Right	2	✓	☐	0.5			0.48
7/3/2024	2:00 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	☐	0.5			0.48
7/3/2024	2:10 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	☐	0.5			0.48
7/3/2024	2:20 PM	LL15 Break Room-Kitchen Faucet	2	✓	☐	1.5	1.1	1.1	
7/3/2024	2:23 PM	Print, Postal Sorting Area Faucet	2	✓	☐		2.0	1.9	

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 06/30/2024 to 07/06/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
7/1/2024	2944136	C207 Janitor's Closet-Mop/Slop Sink
7/2/2024	2944419	Suite. 540 Kitchenette - Faucet
7/3/2024	2944224	Suite 420 Kitchenette - Faucet (NE) - South
7/3/2024	2944132	126-03 Women-Shower-1st from L to R
7/3/2024	2944133	126-03 Women-Shower-2nd from L to R
7/3/2024	2944134	126-03 Women-Shower-3rd from L to R
7/3/2024	2944135	126-03 Women-Shower-4th from L to R
7/3/2024	2944120	126-06 Shower Room - Shower-North-Left
7/3/2024	2944121	126-06 Shower Room-Shower-North-Center
7/3/2024	2944122	126-06 Shower Room - Shower-North-Right
7/3/2024	2944123	126-06 Shower Room - Shower-South-Left
7/3/2024	2944124	126-06 Shower Room-Shower-South-Center
7/3/2024	2944125	126-06 Shower Room - Shower-South-Right

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 06/23/2024 to 06/29/2024

**Definitions**  
**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
6/24/2024	1:06 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	1:06 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	1:48 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	1:48 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	1:48 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	1:55 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	1:58 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	1:58 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	1:58 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	1:58 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	2:18 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.4		
6/24/2024	10:30 AM		C407 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		3.33		
6/24/2024	10:40 AM		4M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	10:40 AM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	10:53 AM		4W-2 Women West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	10:53 AM		4W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	10:53 AM		4W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	11:16 AM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	11:16 AM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	11:27 AM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	0.5			0.75
6/24/2024	11:27 AM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.07
6/24/2024	11:27 AM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	0.5			2.3
6/24/2024	12:03 PM		3W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	12:03 PM		3W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	12:03 PM		3W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	12:25 PM		3M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	12:25 PM		3M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	12:45 PM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	3:04 PM		3M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	3:16 PM		3W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	3:16 PM		3W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	3:16 PM		3W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	3:40 PM		2M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	3:40 PM		2M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	3:50 PM		2W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	3:50 PM		2W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	3:50 PM		2W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	4:11 PM		2M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	4:11 PM		2M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	4:22 PM		2W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	4:22 PM		2W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	4:22 PM		2W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	4:22 PM		C207 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>				
6/24/2024	4:32 PM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	4:45 PM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		0.96		
6/24/2024	4:55 PM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.5		
6/24/2024	5:06 PM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	5:06 PM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	5:06 PM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	5:06 PM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	5:17 PM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	5:17 PM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	5:17 PM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	5:29 PM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	5:29 PM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	5:29 PM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	5:41 PM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.66	1.36	
6/24/2024	5:41 PM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.53	0.58	
6/24/2024	5:55 PM		CLL09-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.57		
6/24/2024	6:12 PM		LLM-1 Men-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	6:12 PM		LLM-1 Men-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	6:25 PM		LLW-1 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	6:25 PM		LLW-1 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
6/24/2024	8:03 PM		10M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

6/24/2024	8:03 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	8:08 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	8:08 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	8:20 PM	10W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	8:21 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/24/2024	8:21 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	8:24 PM	10M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	8:25 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	8:32 PM	10W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/24/2024	8:32 PM	10W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	8:32 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	8:34 PM	Suite 1015 GSA Kitchenette Faucet (1000-03)	2	✓	□	1.5	0.68	1.2	
6/24/2024	8:42 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	□		2.0		
6/24/2024	8:43 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	8:43 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/24/2024	8:43 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	8:45 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	8:45 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	8:50 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	8:51 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	8:54 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	8:54 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/24/2024	8:54 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	8:59 PM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		2.3		
6/24/2024	9:05 PM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	9:06 PM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/24/2024	9:06 PM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	9:10 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	9:10 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	9:14 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/24/2024	9:14 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	9:14 PM	8W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	9:14 PM	C807-Janitor's Closet-Mop/Slop Sink	1	✓	□		2.1		
6/24/2024	9:22 PM	7W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	9:22 PM	7W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/24/2024	9:22 PM	7W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	9:23 PM	7M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	9:23 PM	7M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	9:38 PM	7M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	9:38 PM	7M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	9:38 PM	7W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	9:42 PM	7W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/24/2024	9:42 PM	7W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	9:57 PM	C707-Janitor's Closet-Mop/Slop Sink	1	✓	□		2.4		
6/24/2024	9:57 PM	6M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	9:57 PM	6M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	10:01 PM	6W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	10:01 PM	6W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/24/2024	10:01 PM	6W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	10:05 PM	6M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	10:05 PM	6M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	10:07 PM	6W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/24/2024	10:07 PM	6W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/24/2024	10:07 PM	6W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/24/2024	10:14 PM	C607-Janitor's Closet - Mop/Slop Sink	1	✓	□		2.3		
6/25/2024	8:10 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.25	1.2	
6/25/2024	8:10 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5		0.75	
6/25/2024	8:36 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.5	1.36	
6/25/2024	8:50 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.25	1.36	
6/25/2024	9:05 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.3	1.2	
6/25/2024	9:17 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.2	1.2	
6/25/2024	9:29 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.2	1.2	
6/25/2024	9:41 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.2	1.2	
6/25/2024	9:52 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.2	1.2	
6/25/2024	10:04 AM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.2	1.1	
6/25/2024	10:16 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.2	1.1	
6/25/2024	10:26 AM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.1	1.1	
6/25/2024	10:45 AM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.1	1.2	
6/25/2024	11:00 AM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.2	1.2	
6/25/2024	11:20 AM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.1	1.1	
6/25/2024	11:35 AM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
6/25/2024	12:40 PM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.2	1.2	
6/25/2024	12:53 PM	Suite 532 Lactation Room - Faucet	2	✓	□	1.5	1.2	1.2	
6/25/2024	1:06 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.2	1.2	

6/25/2024	1:18 PM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.5	1.7	1.7	
6/25/2024	1:29 PM	540 Faucet (507-26)	2	✓	□	1.5	1.2	1.2	
6/25/2024	1:41 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.2	1.1	
6/25/2024	1:53 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.2	1.2	
6/25/2024	2:05 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.2	1.2	
6/26/2024	8:08 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.25	1.25	
6/26/2024	8:18 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.11	1.07	
6/26/2024	8:31 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	□	1.5	1.25	1.25	
6/26/2024	8:52 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.15	1.07	
6/26/2024	8:52 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5		0.65	
6/26/2024	9:20 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	□	1.5	1.3	1.3	
6/26/2024	9:35 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	✓	1.5	1.3	1.36	
6/26/2024	9:51 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	□	1.5	1.15	1.07	
6/26/2024	10:26 AM	234 Kitchen Faucet (209-04)	2	✓	□	1.5	1.3	1.3	
6/26/2024	10:55 AM	123-05 Health Unit - Sink/Faucet	2	✓	□	0.5			1.2
6/26/2024	11:13 AM	123-07 Health Unit-Lavatory Faucet	2	✓	✓	0.5			0.48
6/26/2024	11:13 AM	123-08 Health Unit-Lavatory Faucet	2	✓	✓	0.5			0.48
6/26/2024	11:47 AM	128-01 Lactation Room A-Sink/Faucet	2	✓	□	1.5	1.15	1.15	
6/26/2024	11:47 AM	128-03 Lactation Room C-Sink/Faucet	2	✓	□	1.5	1.15	1.15	
6/26/2024	1:09 PM	128-02 Lactation Room B-Sink/Faucet	2	✓	□	1.5	1.15	1.11	
6/26/2024	1:19 PM	128-04 Lactation Room D-Sink/Faucet	2	✓	□	1.5	1.11	1.11	
6/26/2024	1:50 PM	Print, Postal Sorting Area Faucet	2	✓	□		2.5	1.76	
6/26/2024	2:02 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	1.03	0.96	
6/26/2024	2:16 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
6/26/2024	2:27 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
6/26/2024	3:00 PM	126-05 Men-Lavatory Faucet-Left	2	✓	✓	0.5			0.48
6/26/2024	3:22 PM	126-05 Men-Lavatory Faucet-Center	2	✓	□	0.5			0.48
6/26/2024	3:22 PM	126-05 Men-Lavatory Faucet-Right	2	✓	□	0.5			0.48
6/26/2024	3:33 PM	126-06 Shower Room - Shower-North-Left	1	✓	✓	2			1.76
6/26/2024	3:33 PM	126-06 Shower Room-Shower-North-Center	1	✓	□	2			2.50
6/26/2024	3:33 PM	126-06 Shower Room - Shower-North-Right	1	✓	□	2			3.00
6/26/2024	3:54 PM	126-06 Shower Room - Shower-South-Left	1	✓	□	2			2.30
6/26/2024	3:54 PM	126-06 Shower Room-Shower-South-Center	1	✓	□	2			2.5
6/26/2024	3:54 PM	126-06 Shower Room - Shower-South-Right	1	✓	□	2			2.72
6/26/2024	4:34 PM	GSA Suite Kitchenette-Sink/Faucet	2	✓	□	1.5	1.2	1.25	
6/26/2024	4:45 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	□	1.5	2.3	1.66	
6/26/2024	8:17 PM	119-02 Mailroom - Faucet	2	✓	□		0.96	0.92	
6/26/2024	8:32 PM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
6/26/2024	8:34 PM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5			0.48
6/26/2024	8:38 PM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
6/26/2024	8:44 PM	126-03 Women-Shower-1st from L to R	1	✓	□	2			2.2
6/26/2024	8:50 PM	126-03 Women-Shower-2nd from L to R	1	✓	□	2			1.52
6/26/2024	8:56 PM	126-03 Women-Shower-3rd from L to R	1	✓	□	2			2.2
6/26/2024	9:04 PM	126-03 Women-Shower-4th from L to R	1	✓	□	2			2.0
6/26/2024	9:25 PM	119-11 Toilet/Sink Combo	2	✓	□	1.6			
6/26/2024	9:36 PM	119-10 Toilet/Sink Combo	2	✓	□	1.6			
6/26/2024	9:41 PM	119-08 Toilet/Sink Combo-Right	2	✓	□	1.6			
6/26/2024	9:48 PM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6			
6/26/2024	9:54 PM	119-07 Toilet/Sink Combo-Right	2	✓	□	1.6			
6/26/2024	9:56 PM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6			
6/26/2024	10:00 PM	119-16A Shower	2	✓	□				1.6

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 06/23/2024 to 06/29/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
6/25/2024	2944419	Suite. 540 Kitchenette - Faucet
6/25/2024	2944278	Suite 615 Break Room-Kitchen Faucet (607-06)
6/25/2024	2945143	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)
6/25/2024	2944260	Suite 520 Kitchenette Faucet (508-13)
6/26/2024	2944222	Suite 415 Kitchenette - Faucet (N)
6/26/2024	2944088	119-17 Toilet/Sink Combo
6/26/2024	2944089	119-19 Food Storage Room-Sink/Faucet
6/26/2024	2944086	119-21 Faucet/Eyewash

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 07/07/2024 to 07/13/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
7/8/2024	8:00 AM		C407 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.14		
7/8/2024	8:17 AM		4M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	8:17 AM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	8:28 AM		4W-2 Women West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	8:28 AM		4W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	8:28 AM		4W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	8:59 AM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	8:59 AM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	9:08 AM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.55
7/8/2024	9:08 AM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			3.33
7/8/2024	9:08 AM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			3.33
7/8/2024	9:30 AM		10M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	9:31 AM		3W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	9:31 AM		3W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	9:31 AM		3W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	9:32 AM		10M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	9:43 AM		10W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	9:43 AM		10W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	9:45 AM		10W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	9:56 AM		3M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	9:56 AM		3M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:00 AM		10M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:01 AM		10M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:05 AM		10W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:05 AM		10W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:05 AM		10W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:09 AM		3M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:12 AM		C1007-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
7/8/2024	10:15 AM		9W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:16 AM		9W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:16 AM		9W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:18 AM		9M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:18 AM		9M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:20 AM		3W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:20 AM		3W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:20 AM		3W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:23 AM		9M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:29 AM		9M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:32 AM		9W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:32 AM		9W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:32 AM		9W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:39 AM		C907-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2		
7/8/2024	10:40 AM		8W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:41 AM		8W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:41 AM		8W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:41 AM		2M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:41 AM		2M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:46 AM		8M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			48
7/8/2024	10:46 AM		8M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			48
7/8/2024	10:48 AM		8M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:49 AM		8M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:50 AM		8W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:50 AM		8W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:50 AM		8W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:52 AM		2W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:52 AM		2W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:52 AM		2W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:56 AM		C807-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
7/8/2024	10:58 AM		7W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:59 AM		7W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	10:59 AM		7W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	11:03 AM		7M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	11:03 AM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/8/2024	11:03 AM		2M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

7/8/2024	11:03 AM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	11:03 AM	C207 Janitor's Closet-Mop/Slop Sink	1	✓	□				
7/8/2024	11:09 AM	7M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	11:09 AM	7M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	11:12 AM	7W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	11:12 AM	7W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/8/2024	11:12 AM	7W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	11:14 AM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	11:14 AM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/8/2024	11:14 AM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	11:17 AM	C707-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.9		
7/8/2024	11:24 AM	Suite 1015 GSA Kitchenette Faucet (1000-03)	2	✓	□	1.5	66	1.16	
7/8/2024	12:00 PM	E201 Restroom - Lavatory Faucet	1	✓	✓	0.5			0.48
7/8/2024	1:15 PM	108-4 Cafe Prep. - Kitchen Faucet-Small	1	✓	□	1.5	1.57	1.25	
7/8/2024	1:15 PM	108-4 Cafe Prep. - Kitchen Faucet-Large	1	✓	□	1.5	1.25	1.11	
7/8/2024	1:30 PM	1U-1 Loading Dock - Lavatory Faucet	2	✓	□	0.5			0.48
7/8/2024	1:42 PM	114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	✓	✓		1.03		
7/8/2024	2:00 PM	C105-1 Janitor's Closet - Mop/Slop Sink	1	✓	✓		1.66		
7/8/2024	3:30 PM	1W-2 Women's Restroom South - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	3:30 PM	1W-2 Women's Restroom South - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	3:44 PM	1M-2 Men's Restroom South - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	3:44 PM	1M-2 Men's Restroom South - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	3:55 PM	1W-1 Women's Restroom North - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	3:55 PM	1W-1 Women's Restroom North - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/8/2024	3:55 PM	1W-1 Women's Restroom North - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	3:57 PM	6W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	3:57 PM	6W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/8/2024	3:58 PM	6W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:00 PM	6M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	4:00 PM	6M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:07 PM	1M-1 Men's Restroom North - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	4:07 PM	1M-1 Men's Restroom North - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/8/2024	4:07 PM	1M-1 Men's Restroom North - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:18 PM	6M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:19 PM	CLL09-1 Janitor's Closet - Mop/Slop Sink	1	✓	□		2		
7/8/2024	4:20 PM	6M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	4:23 PM	6W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	4:23 PM	6W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/8/2024	4:23 PM	6W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:24 PM	C607-Janitor's Closet - Mop/Slop Sink	1	✓	□		1.8		
7/8/2024	4:30 PM	5W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:30 PM	LLM-1 Men-Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	4:30 PM	LLM-1 Men-Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:32 PM	5W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	4:32 PM	5W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/8/2024	4:34 PM	5M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	4:34 PM	5M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:38 PM	5M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:39 PM	5M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	4:41 PM	5W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	4:41 PM	5W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/8/2024	4:41 PM	5W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:42 PM	LLW-1 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/8/2024	4:42 PM	LLW-1 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/8/2024	4:50 PM	C507 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.9		
7/9/2024	8:17 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.25	1.25	
7/9/2024	8:30 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	✓	1.5	1.15	1.11	
7/9/2024	8:30 AM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	✓	1.5		0.69	
7/9/2024	8:50 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	✓	1.5	1.3	1.36	
7/9/2024	8:50 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	✓	1.5		0.76	
7/9/2024	9:10 AM	Suite 608 Kitchen - Faucet	2	✓	✓	1.5	1.36	1.36	
7/9/2024	9:22 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.2	1.2	
7/9/2024	9:45 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.25	1.36	
7/9/2024	10:05 AM	Suite 710 Faucet (710-03)	2	✓	✓	1.5	1.07	1.11	
7/9/2024	2:00 PM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.11	1.11	
7/9/2024	2:15 PM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.15	1.11	
7/9/2024	2:20 PM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.2	1.25	
7/9/2024	2:30 PM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.3	1.2	
7/9/2024	2:42 PM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.25	1.2	
7/9/2024	2:55 PM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.11	1.25	
7/9/2024	3:05 PM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
7/9/2024	3:12 PM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.2	1.3	
7/9/2024	3:25 PM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.3	1.25	
7/9/2024	3:40 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1	1	

7/9/2024	3:56 PM	540 Faucet (507-26)	2	✓	☐	1.5	1.11	1.07	
7/9/2024	4:08 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	☐	1.5	1.2	1.15	
7/9/2024	4:22 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	☐	1.5	1.15	1.07	
7/9/2024	4:37 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	☐	1.5	1.2	1.2	
7/9/2024	4:50 PM	540 Faucet (507-26) A (Second fixture)	2	✓	☐	1.5	1.3	1.25	
7/9/2024	5:05 PM	Suite 532 Lactation Room - Faucet	2	✓	☐	1.5	1.15	1.15	
7/9/2024	5:20 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	☐	1.5	1.2	1.15	
7/10/2024	8:11 AM	119-02 Mailroom - Faucet	2	✓	☐		1.08	1.00	
7/10/2024	8:23 AM	119-19 Food Storage Room-Sink/Faucet	2	✓	☐	1.6	0.84	0.8	
7/10/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	☐	1.5	0.13	0.13	
7/10/2024	8:30 AM	119-21 Faucet/Eyewash	2	✓	☐		0.88	0.8	
7/10/2024	8:33 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	☐	1.5		0.34	
7/10/2024	8:45 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	☑	1.5	1.2	1.2	
7/10/2024	9:00 AM	Suite 415 Kitchenette - Faucet (N)	2	✓	☐	1.5	2.1	2	
7/10/2024	9:14 AM	119-11 Toilet/Sink Combo	2	✓	☐	1.6			
7/10/2024	9:15 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	☐	1.5	1.2	1.2	
7/10/2024	9:20 AM	119-16A Shower	2	✓	☐				1.8
7/10/2024	9:25 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	☐	1.5	1.2	1.2	
7/10/2024	9:33 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	☐	1.5	1.2	1.2	
7/10/2024	9:35 AM	234 Kitchen Faucet (209-04)	2	✓	☐	1.5	1.2	1.3	
7/10/2024	9:40 AM	119-10 Toilet/Sink Combo	2	✓	☐	1.6			
7/10/2024	9:45 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	☐	1.5	1.2	1.2	
7/10/2024	9:46 AM	119-07 Toilet/Sink Combo-Right	2	✓	☐	1.6			
7/10/2024	9:48 AM	119-07 Toilet/Sink Combo-Left	2	✓	☐	1.6			
7/10/2024	9:56 AM	126-02 Women-Lavatory Faucet-Right	1	✓	☐	0.5			0.48
7/10/2024	9:57 AM	119-08 Toilet/Sink Combo-Left	2	✓	☐	1.6			
7/10/2024	9:57 AM	119-08 Toilet/Sink Combo-Right	2	✓	☐	1.6			
7/10/2024	9:58 AM	126-02 Women-Lavatory Faucet-Left	1	✓	☐	0.5			0.48
7/10/2024	9:58 AM	126-02 Women-Lavatory Faucet-Center	1	✓	☐	0.5			0.48
7/10/2024	10:00 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	☐	1.5	1.3	1.3	
7/10/2024	10:11 AM	126-03 Women-Shower-1st from L to R	1	✓	☐	2			216
7/10/2024	10:15 AM	123-05 Health Unit - Sink/Faucet	2	✓	☐	0.5			1.2
7/10/2024	10:18 AM	126-03 Women-Shower-2nd from L to R	1	✓	☐	2			1.9
7/10/2024	10:19 AM	126-03 Women-Shower-3rd from L to R	1	✓	☐	2			1.8
7/10/2024	10:20 AM	123-07 Health Unit-Lavatory Faucet	2	✓	☐	0.5			0.4
7/10/2024	10:21 AM	126-03 Women-Shower-4th from L to R	1	✓	☐	2			1.2
7/10/2024	10:24 AM	126-05 Men-Lavatory Faucet-Center	2	✓	☐	0.5			0.48
7/10/2024	10:25 AM	126-05 Men-Lavatory Faucet-Left	2	✓	☐	0.5			0.48
7/10/2024	10:26 AM	126-05 Men-Lavatory Faucet-Right	2	✓	☐	0.5			0.48
7/10/2024	10:30 AM	123-08 Health Unit-Lavatory Faucet	2	✓	☐	0.5			0.42
7/10/2024	10:33 AM	126-06 Shower Room - Shower-North-Left	1	✓	☐	2			2
7/10/2024	10:35 AM	126-06 Shower Room-Shower-North-Center	1	✓	☐	2			4
7/10/2024	10:37 AM	126-06 Shower Room - Shower-North-Right	1	✓	☐	2			1.8
7/10/2024	10:39 AM	126-06 Shower Room - Shower-South-Left	1	✓	☐	2			22
7/10/2024	10:41 AM	126-06 Shower Room-Shower-South-Center	1	✓	☐	2			22
7/10/2024	10:45 AM	128-03 Lactation Room C-Sink/Faucet	2	✓	☐	1.5	1.2	1.2	
7/10/2024	10:46 AM	126-06 Shower Room - Shower-South-Right	1	✓	☐	2			62
7/10/2024	10:50 AM	128-02 Lactation Room B-Sink/Faucet	2	✓	☐	1.5	1.2	1.3	
7/10/2024	10:55 AM	128-01 Lactation Room A-Sink/Faucet	2	✓	☐	1.5	1.2	1.2	
7/10/2024	11:10 AM	GSA Suite Kitchenette-Sink/Faucet	2	✓	☐	1.5	1.3	1.3	

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 07/07/2024 to 07/13/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
7/9/2024	2944419	Suite. 540 Kitchenette - Faucet
7/9/2024	2944259	Suite 530 Kitchenette - Faucet (509-10)
7/10/2024	2944106	113-6 JLL Kitchenette-Kitchen Faucet
7/10/2024	2944088	119-17 Toilet/Sink Combo

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 07/14/2024 to 07/20/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
7/15/2024	5:12 AM		Suite 1015 GSA Kitchenette Faucet (1000-03)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	70	126	
7/15/2024	8:12 AM		10M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:13 AM		10M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:15 AM		10W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:18 AM		10W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:18 AM		10W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:34 AM		10M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:36 AM		10M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:39 AM		10W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:39 AM		10W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:39 AM		10W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:40 AM		8M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:40 AM		8M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:42 AM		C1007-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
7/15/2024	8:44 AM		9W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:45 AM		9W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:45 AM		9W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:47 AM		9M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:47 AM		9M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:49 AM		9M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:50 AM		9M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:50 AM		9W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:50 AM		9W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:50 AM		9W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:54 AM		C907-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.5		
7/15/2024	8:57 AM		8W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:58 AM		8W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	8:58 AM		8W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:04 AM		8M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:05 AM		8M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:08 AM		8W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:08 AM		8W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:09 AM		8W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:10 AM		C807-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.9		
7/15/2024	9:12 AM		7W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:13 AM		7W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:13 AM		7W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:15 AM		7M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:15 AM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:27 AM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:28 AM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:30 AM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:30 AM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:33 AM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:35 AM		LLM-1 Men-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:36 AM		LLM-1 Men-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:40 AM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:42 AM		4M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:42 AM		4W-2 Women West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:42 AM		4W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:44 AM		LLW-1 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:45 AM		LLW-1 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:47 AM		4W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:47 AM		CLL09-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
7/15/2024	9:48 AM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:50 AM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:50 AM		C407 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
7/15/2024	9:52 AM		3W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:53 AM		3W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:54 AM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:54 AM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:55 AM		3M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:55 AM		3M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/15/2024	9:56 AM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

7/15/2024	9:56 AM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	10:02 AM	C707-Janitor's Closet-Mop/Slop Sink	1	✓	□		18		
7/15/2024	10:10 AM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	10:17 AM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	10:17 AM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/15/2024	10:17 AM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	10:25 AM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	10:26 AM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	10:26 AM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/15/2024	10:28 AM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	10:28 AM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	10:39 AM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	10:39 AM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	10:39 AM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	10:39 AM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/15/2024	10:39 AM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	10:59 AM	C207 Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
7/15/2024	11:15 AM	E201 Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
7/15/2024	11:40 AM	6M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	11:41 AM	6M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	11:50 AM	6W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	11:50 AM	6W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/15/2024	11:54 AM	6W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	4:09 PM	1W-2 Women's Restroom South - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	4:09 PM	1W-2 Women's Restroom South - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	4:10 PM	C105-1 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.8		
7/15/2024	4:13 PM	1M-2 Men's Restroom South - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	4:13 PM	1M-2 Men's Restroom South - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	4:26 PM	114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	✓	□		1.7		
7/15/2024	4:36 PM	1U-1 Loading Dock - Lavatory Faucet	2	✓	□	0.5			0.48
7/15/2024	4:47 PM	1W-1 Women's Restroom North - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	4:47 PM	1W-1 Women's Restroom North - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/15/2024	4:53 PM	1M-1 Men's Restroom North - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	4:53 PM	1M-1 Men's Restroom North - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/15/2024	4:55 PM	1W-1 Women's Restroom North - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	4:55 PM	1M-1 Men's Restroom North - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	5:00 PM	108-4 Cafe Prep. - Kitchen Faucet-Small	1	✓	□	1.5	70	124	
7/15/2024	5:00 PM	108-4 Cafe Prep. - Kitchen Faucet-Large	1	✓	□	1.5	71	121	
7/15/2024	5:02 PM	6M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	5:02 PM	6M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	5:11 PM	C607-Janitor's Closet - Mop/Slop Sink	1	✓	□		1.7		
7/15/2024	5:13 PM	5W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	5:13 PM	5W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/15/2024	5:13 PM	5W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	5:16 PM	5M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	5:17 PM	5M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	5:20 PM	5M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	5:20 PM	5M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	5:23 PM	5W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	5:23 PM	5W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/15/2024	5:23 PM	5W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/15/2024	5:26 PM	C507 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.8		
7/15/2024	5:08PM	6W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/15/2024	5:08PM	6W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/15/2024	5:08PM	6W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/16/2024	8:15 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.3	1.3	
7/16/2024	8:16 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5		0.32	
7/16/2024	8:35 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.2	1.3	
7/16/2024	8:35 AM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	□	1.5		0.28	
7/16/2024	8:55 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	✓	1.5	1.2	1.2	
7/16/2024	9:20 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.2	1.2	
7/16/2024	9:20 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.2	1.2	
7/16/2024	9:20 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.2	1.2	
7/16/2024	9:40 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.2	1.2	
7/16/2024	9:50 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.2	1.3	
7/16/2024	10:05 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.2	1.2	
7/16/2024	10:10 AM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.2	1.2	
7/16/2024	10:10 AM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
7/16/2024	10:20 AM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.3	1.3	
7/16/2024	10:20 AM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.3	1.2	
7/16/2024	10:30 AM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.2	1.2	
7/16/2024	10:50 AM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5			
7/16/2024	11:00 AM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.2	1.2	
7/16/2024	11:10 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.3	1.3	

7/16/2024	12:45 PM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.5	1.4	1.4	
7/16/2024	1:00 PM	540 Faucet (507-26)	2	✓	□	1.5	1.2	1.2	
7/16/2024	1:15 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.2	1.2	
7/16/2024	1:30 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.2	1.2	
7/16/2024	1:40 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5			
7/16/2024	1:50 PM	Suite 532 Lactation Room - Faucet	2	✓	□	1.5	1.2	1.2	
7/16/2024	2:00 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.2	1.3	
7/17/2024	8:16 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.03	1.03	
7/17/2024	8:40 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	✓	1.5	1.07	1.11	
7/17/2024	8:40 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	✓	1.5	1.11	1.11	
7/17/2024	9:02 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	✓	1.5	1.2	1.2	
7/17/2024	9:32 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5			0.55
7/17/2024	10:02 AM	234 Kitchen Faucet (209-04)	2	✓	✓	1.5	1.23	1.2	
7/17/2024	10:35 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	□	1.5	1.2	1.2	
7/17/2024	10:47 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	□	1.5	1.25	1.36	
7/17/2024	11:00 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	□	1.5	1.11	1.07	
7/17/2024	1:20 PM	123-05 Health Unit - Sink/Faucet	2	✓	✓	0.5			1.07
7/17/2024	1:47 PM	123-07 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
7/17/2024	1:47 PM	123-08 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
7/17/2024	2:00 PM	Suite 415 Kitchenette - Faucet (N)	2	✓	□	1.5	2.8	2.7	
7/17/2024	2:28 PM	128-01 Lactation Room A-Sink/Faucet	2	✓	✓	1.5	1.15	1.11	
7/17/2024	2:28 PM	128-02 Lactation Room B-Sink/Faucet	2	✓	✓	1.5	1.15	1.11	
7/17/2024	2:28 PM	128-03 Lactation Room C-Sink/Faucet	2	✓	✓	1.5	1.11	1.11	
7/17/2024	2:31 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	□	1.5	2	1.5	
7/17/2024	3:20 PM	128-04 Lactation Room D-Sink/Faucet	2	✓	✓	1.5	1.11	1.03	
7/17/2024	3:31 PM	Print, Postal Sorting Area Faucet	2	✓	□		2.14	1.66	
7/17/2024	3:42 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	1.03	0.93	
7/17/2024	3:57 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
7/17/2024	4:10 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
7/17/2024	4:23 PM	GSA Suite Kitchenette-Sink/Faucet	2	✓	✓	1.5	1.2	1.2	
7/17/2024	4:40 PM	126-05 Men-Lavatory Faucet-Left	2	✓	□	0.5			0.48
7/17/2024	4:40 PM	126-05 Men-Lavatory Faucet-Center	2	✓	✓	0.5			0.48
7/17/2024	4:40 PM	126-05 Men-Lavatory Faucet-Right	2	✓	✓	0.5			0.48
7/17/2024	5:20 PM	126-06 Shower Room - Shower-North-Left	1	✓	□	2			2.5
7/17/2024	5:20 PM	126-06 Shower Room-Shower-North-Center	1	✓	□	2			2.3
7/17/2024	5:20 PM	126-06 Shower Room - Shower-North-Right	1	✓	□	2			2.3
7/17/2024	5:31 PM	126-06 Shower Room - Shower-South-Left	1	✓	□	2			2.14
7/17/2024	5:31 PM	126-06 Shower Room-Shower-South-Center	1	✓	□	2			2.3
7/17/2024	5:31 PM	126-06 Shower Room - Shower-South-Right	1	✓	□	2			2.3
7/17/2024	5:45 PM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/17/2024	5:45 PM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/17/2024	5:45 PM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/17/2024	6:18 PM	126-03 Women-Shower-1st from L to R	1	✓	✓	2			2.5
7/17/2024	6:18 PM	126-03 Women-Shower-2nd from L to R	1	✓	✓	2			2.3
7/17/2024	6:18 PM	126-03 Women-Shower-3rd from L to R	1	✓	✓	2			2.14
7/17/2024	6:18 PM	126-03 Women-Shower-4th from L to R	1	✓	✓	2			2.5
7/17/2024	10:03 PM	119-02 Mailroom - Faucet	2	✓	□		1.1	1	
7/17/2024	10:03 PM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6			
7/17/2024	10:03 PM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6			
7/17/2024	10:03 PM	119-10 Toilet/Sink Combo	2	✓	□	1.6			
7/17/2024	10:03 PM	119-11 Toilet/Sink Combo	2	✓	□	1.6			
7/17/2024	10:03 PM	119-16A Shower	2	✓	□				1.4
7/17/2024	10:03 PM	119-17 Toilet/Sink Combo	2	✓	□	1.6			
7/17/2024	10:03 PM	119-19 Food Storage Room-Sink/Faucet	2	✓	□	1.6	1.1	1.0	
7/17/2024	10:03 PM	119-21 Faucet/Eyewash	2	✓	□		1.2	1.2	

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 07/14/2024 to 07/20/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
7/16/2024	2944419	Suite. 540 Kitchenette - Faucet
7/16/2024	2944379	Suite 908 Break Room Faucet (908-15)
7/17/2024	2944095	119-08 Toilet/Sink Combo-Right
7/17/2024	2944093	119-07 Toilet/Sink Combo-Right

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 07/21/2024 to 07/27/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
7/22/2024	5:02 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	5:02 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	5:16 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	5:16 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	5:16 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	5:28 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	0.75	1.21	
7/22/2024	5:28 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.6	1.21	
7/22/2024	6:06 AM		CLL09-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		0.56		
7/22/2024	6:06 AM		LLM-1 Men-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.68
7/22/2024	6:06 AM		LLM-1 Men-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.62
7/22/2024	6:06 AM		LLW-1 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.63
7/22/2024	6:06 AM		LLW-1 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.71
7/22/2024	9:39 AM		10W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	9:39 AM		10W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	9:39 AM		10W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	9:43 AM		10M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	9:43 AM		10M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	9:51 AM		10M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	9:54 AM		10W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	9:54 AM		10W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	9:54 AM		10W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	9:58 AM		C1007-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
7/22/2024	10:01 AM		9W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:01 AM		9W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:01 AM		9W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:04 AM		9M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:04 AM		9M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:09 AM		9M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:09 AM		9M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:10 AM		9W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:11 AM		9W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:11 AM		9W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:15 AM		C907-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.9		
7/22/2024	10:17 AM		8W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:17 AM		8W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:17 AM		8W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:19 AM		8M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:19 AM		8M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:23 AM		8M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:24 AM		8M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:25 AM		8W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:25 AM		8W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:28 AM		8W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:28 AM		C807-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
7/22/2024	10:29 AM		7W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:50 AM		Suite 1015 GSA Kitchenette Faucet (1000-03)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	66	120	
7/22/2024	10:56 AM		7W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:56 AM		7W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:57 AM		7M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	10:57 AM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	11:01 AM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	11:01 AM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	11:06 AM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	11:06 AM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	11:06 AM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	11:17 AM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
7/22/2024	3:39 PM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	3:39 PM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	3:39 PM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	3:41 PM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	3:41 PM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	3:51 PM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	3:51 PM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/22/2024	3:51 PM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		

7/22/2024	3:53 PM	6W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	3:53 PM	6W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/22/2024	3:53 PM	6W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	3:59 PM	5W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	3:59 PM	5W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/22/2024	3:59 PM	5W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	4:01 PM	5M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	4:03 PM	5M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	4:06 PM	5M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	4:07 PM	5M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	4:09 PM	5W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	4:09 PM	5W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/22/2024	4:09 PM	5W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	4:12 PM	C507 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.6		
7/22/2024	6:00 PM	C407 Janitor's Closet-Mop/Slop Sink	1	✓	□		2		
7/22/2024	6:12 PM	4M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	6:12 PM	4M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	6:25 PM	4W-2 Women's Restroom West-Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	6:25 PM	4W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/22/2024	6:25 PM	4W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	6:46 PM	4M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	6:46 PM	4M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	6:57 PM	4W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.5
7/22/2024	6:57 PM	4W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			1.87
7/22/2024	6:57 PM	4W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			2.72
7/22/2024	7:16 PM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	7:16 PM	3W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/22/2024	7:16 PM	3W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	7:40 PM	3M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	7:40 PM	3M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	7:52 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	8:03 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	8:03 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/22/2024	8:03 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	8:30 PM	E201 Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
7/22/2024	8:49 PM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	8:49 PM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	9:00 PM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	9:00 PM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/22/2024	9:00 PM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	9:22 PM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	9:22 PM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	9:22 PM	C207 Janitor's Closet-Mop/Slop Sink	1	✓	□				
7/22/2024	9:35 PM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	9:35 PM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/22/2024	9:35 PM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	9:36 PM	1U-1 Loading Dock - Lavatory Faucet	2	✓	□	0.5			0.48
7/22/2024	9:48 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	9:49 PM	114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	✓	□		3.75		
7/22/2024	10:04 PM	C105-1 Janitor's Closet - Mop/Slop Sink	1	✓	□		5		
7/22/2024	10:14 PM	1W-2 Women's Restroom South - Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/22/2024	10:14 PM	1W-2 Women's Restroom South - Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/22/2024	10:36 PM	1W-1 Women's Restroom North - Lavatory Faucet-Right	1	✓	✓	0.5			0.48
7/22/2024	10:36 PM	1W-1 Women's Restroom North - Lavatory Faucet-Center	1	✓	✓	0.5			0.48
7/22/2024	10:36 PM	1W-1 Women's Restroom North - Lavatory Faucet-Left	1	✓	✓	0.5			0.48
7/23/2024	8:28 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.07	1.11	
7/23/2024	8:28 AM	Suite 615 Break Room-Kitchen Faucet (607-06) A (Second fixture)	2	✓	□	1.5		0.73	
7/23/2024	8:50 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.2	1.25	
7/23/2024	9:05 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.3	1.3	
7/23/2024	9:05 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5		0.78	
7/23/2024	9:39 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.42	1.36	
7/23/2024	9:56 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.3	1.25	
7/23/2024	10:24 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.2	1.11	
7/23/2024	10:38 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.11	1.07	
7/23/2024	10:55 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.11	1.07	
7/23/2024	11:10 AM	Suite 808A Break Room Faucet (809-02)	1	✓	✓	1.5	1.15	1.11	
7/23/2024	2:28 PM	Suite 910A Faucet (910-05)	2	✓	✓	1.5	1.25	1.2	
7/23/2024	2:50 PM	Suite 908 Break Room Faucet (908-15)	2	✓	✓	1.5	1.2	1.25	
7/23/2024	3:17 PM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.25	1.2	
7/23/2024	3:54 PM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.2	1.15	
7/23/2024	4:02 PM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
7/23/2024	4:24 PM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.25	1.2	
7/23/2024	4:38 PM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.2	1.2	
7/23/2024	4:51 PM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.2	1.25	

7/23/2024	4:51 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1.11	1.15	
7/23/2024	5:02 PM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.5	1.25	1.25	
7/23/2024	5:12 PM	540 Faucet (507-26)	2	✓	□	1.5	1.1	1.07	
7/23/2024	5:22 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.2	1.2	
7/23/2024	5:33 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.15	1.2	
7/23/2024	5:43 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.25	1.2	
7/23/2024	6:22 PM	Suite 532 Lactation Room - Faucet	2	✓	□	1.5	1.2	1.25	
7/23/2024	6:33 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.2	1.2	
7/24/2024	7:28 AM	119-21 Faucet/Eyewash	2	✓	□		1	1.2	
7/24/2024	8:00 AM	119-07 Toilet/Sink Combo-Right	2	✓	□	1.6			
7/24/2024	8:08 AM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6			
7/24/2024	8:09 AM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6			
7/24/2024	8:18 AM	119-11 Toilet/Sink Combo	2	✓	□	1.6			
7/24/2024	8:22 AM	119-08 Toilet/Sink Combo-Right	2	✓	□	1.6			
7/24/2024	8:24 AM	119-10 Toilet/Sink Combo	2	✓	□	1.6			
7/24/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.2	1.2	
7/24/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5	1.2	1.2	
7/24/2024	8:33 AM	119-19 Food Storage Room-Sink/Faucet	2	✓	□	1.6	0.88	0.72	
7/24/2024	8:40 AM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/24/2024	8:40 AM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/24/2024	8:40 AM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/24/2024	8:40 AM	126-03 Women-Shower-1st from L to R	1	✓	□	2			4.1
7/24/2024	8:45 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.2	1.3	
7/24/2024	8:53 AM	126-03 Women-Shower-2nd from L to R	1	✓	□	2			1.5
7/24/2024	8:59 AM	126-03 Women-Shower-3rd from L to R	1	✓	□	2			0.8
7/24/2024	9:00 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.2	1.2	
7/24/2024	9:00 AM	119-17 Toilet/Sink Combo	2	✓	□	1.6			
7/24/2024	9:01 AM	126-03 Women-Shower-4th from L to R	1	✓	□	2			0.2
7/24/2024	9:03 AM	126-05 Men-Lavatory Faucet-Left	2	✓	□	0.5			0.48
7/24/2024	9:04 AM	126-05 Men-Lavatory Faucet-Center	2	✓	□	0.5			0.48
7/24/2024	9:04 AM	126-05 Men-Lavatory Faucet-Right	2	✓	□	0.5			0.48
7/24/2024	9:12 AM	126-06 Shower Room - Shower-South-Right	1	✓	□	2			2.08
7/24/2024	9:20 AM	234 Kitchen Faucet (209-04)	2	✓	□	1.5	1.3	1.3	
7/24/2024	9:20 AM	126-06 Shower Room-Shower-South-Center	1	✓	□	2			2.3
7/24/2024	9:23 AM	126-06 Shower Room - Shower-South-Left	1	✓	□	2			1.7
7/24/2024	9:25 AM	126-06 Shower Room - Shower-North-Right	1	✓	□	2			4.2
7/24/2024	9:28 AM	126-06 Shower Room-Shower-North-Center	1	✓	□	2			2
7/24/2024	9:30 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	□	1.5	1.3	1.3	
7/24/2024	9:30 AM	119-16A Shower	2	✓	□				1.2
7/24/2024	9:32 AM	126-06 Shower Room - Shower-North-Left	1	✓	□	2			4
7/24/2024	9:45 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	□	1.5	1.3	1.3	
7/24/2024	10:00 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	□	1.5	1.2	1.2	
7/24/2024	10:15 AM	123-05 Health Unit - Sink/Faucet	2	✓	□	0.5			1.3
7/24/2024	10:20 AM	123-07 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
7/24/2024	10:35 AM	123-08 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
7/24/2024	10:45 AM	GSA Suite Kitchenette-Sink/Faucet	2	✓	□	1.5	1.2	1.2	
7/24/2024	10:45 AM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	□	1.5	1.4	1.4	
7/24/2024	10:45 AM	119-02 Mailroom - Faucet	2	✓	□		1.2	1.4	
7/24/2024	11:00 AM	Suite 415 Kitchenette - Faucet (N)	2	✓	□	1.5	1.4	1.4	
7/24/2024	11:15 AM	128-01 Lactation Room A-Sink/Faucet	2	✓	□	1.5	1.2	1.2	
7/24/2024	11:20 AM	128-02 Lactation Room B-Sink/Faucet	2	✓	□	1.5	1.3	1.2	
7/24/2024	11:25 AM	128-03 Lactation Room C-Sink/Faucet	2	✓	□	1.5	1.2	1.2	
7/24/2024	11:30 AM	128-04 Lactation Room D-Sink/Faucet	2	✓	□	1.5	1.2	1.2	
7/24/2024	1:00 PM	Print, Postal Sorting Area Faucet	2	✓	□		1.4	1.4	
7/24/2024	1:15 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	1.2	1.2	
7/24/2024	1:35 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
7/24/2024	1:45 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
7/24/2024	9:10 PM	Suite 410 Kitchenette Faucet (NW)	2	✓	□	1.5	1.2	1.2	

**Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Exception Report  
From 07/21/2024 to 07/27/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
7/23/2024	2944419	Suite. 540 Kitchenette - Faucet

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 07/28/2024 to 08/03/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
7/29/2024	12:03 AM		7W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	12:04 AM		7W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	12:05 AM		7W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	12:14 AM		7M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.5
7/29/2024	12:15 AM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	12:23 AM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			3.6
7/29/2024	12:24 AM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			2.9
7/29/2024	12:26 AM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	12:27 AM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	12:28 AM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	2:39 AM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
7/29/2024	2:40 AM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	2:41 AM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	2:42 AM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	2:48 AM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	2:49 AM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	2:59 AM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:00 AM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:01 AM		6W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:04 AM		6W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:05 AM		6W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:15 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
7/29/2024	3:21 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:22 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:23 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:28 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:28 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:29 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
7/29/2024	3:35 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:35 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.68	1.21	
7/29/2024	3:35 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.67	1.21	
7/29/2024	3:39 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:39 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:39 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:43 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.5		
7/29/2024	3:45 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:46 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:48 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:49 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:50 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:51 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:52 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:52 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	3:53 AM		CLL09-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
7/29/2024	4:00 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
7/29/2024	4:02 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	4:06 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	4:06 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	4:22 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	4:40 AM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	2:15 PM		Suite 1015 GSA Kitchenette Faucet (1000-03)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
7/29/2024	8:08 PM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:08 PM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:08 PM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:08 PM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:20 PM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:29 PM		4W-2 Women West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:29 PM		4W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:29 PM		4W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:30 PM		4M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:30 PM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:34 PM		C407 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
7/29/2024	8:37 PM		3M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
7/29/2024	8:37 PM		3M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

7/29/2024	8:39 PM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	8:39 PM	3W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5		0.48
7/29/2024	8:39 PM	3W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	8:45 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	8:45 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	8:45 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5		0.48
7/29/2024	8:45 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	8:54 PM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5		0.48
7/29/2024	8:54 PM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	8:56 PM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	8:56 PM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	8:56 PM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	8:58 PM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	8:59 PM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	9:00 PM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	9:00 PM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5		0.48
7/29/2024	9:00 PM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	9:09 PM	LLM-1 Men-Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	9:09 PM	LLM-1 Men-Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	9:16 PM	LLW-1 Women-Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	9:16 PM	LLW-1 Women-Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	9:41 PM	10M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	9:42 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	9:47 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5		0.48
7/29/2024	9:48 PM	10W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	9:49 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	9:55 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	9:56 PM	10M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	10:03 PM	10W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5		0.48
7/29/2024	10:04 PM	10W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	10:05 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	10:13 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.8	
7/29/2024	10:18 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	10:19 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5		0.48
7/29/2024	10:20 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	10:28 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	10:29 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	10:36 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	10:37 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	10:39 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	10:40 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5		0.48
7/29/2024	10:41 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	10:50 PM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.7	
7/29/2024	11:04 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	11:08 PM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	11:09 PM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5		0.48
7/29/2024	11:09 PM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	11:18 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	11:19 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	11:23 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5		0.48
7/29/2024	11:24 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	11:25 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5		0.48
7/29/2024	11:25 PM	8W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5		0.48
7/29/2024	11:52 PM	C807-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6	
7/30/2024	8:30 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.2	1.2
7/30/2024	8:30 AM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	□	1.5	1.2	1.3
7/30/2024	8:40 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.3	1.3
7/30/2024	8:40 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5	1.2	1.2
7/30/2024	8:50 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.2	1.2
7/30/2024	9:05 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.3	1.3
7/30/2024	9:15 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.2	1.2
7/30/2024	9:25 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.2	1.2
7/30/2024	9:35 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.3	1.3
7/30/2024	9:45 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.2	1.3
7/30/2024	9:55 AM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.3	1.3
7/30/2024	10:05 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.2	1.2
7/30/2024	10:15 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.2	1.2
7/30/2024	11:10 AM	Suite 1010 Lavatory Faucet	1	✓	□	1.5		0.48
7/30/2024	12:00 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1.3	1.2
7/30/2024	12:10 PM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.2	1.2
7/30/2024	12:20 PM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.2	1.2
7/30/2024	1:00 PM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.2	1.2
7/30/2024	1:25 PM	Suite 532 Lactation Room - Faucet	2	✓	□	1.5	1.2	1.2
7/30/2024	1:39 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.2	1.2

7/30/2024	1:45 PM	540 Faucet (507-26)	2	✓	□	1.5	1.2	1.2	
7/30/2024	1:50 PM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.5	1.4	1.4	
7/30/2024	2:00 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.2	1.2	
7/30/2024	2:10 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.2	1.2	
7/30/2024	2:15 PM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.2	1.2	
7/30/2024	2:26 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.2	1.2	
7/30/2024	11:30 PM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.3	1.3	
7/31/2024	8:08 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.20	1.20	
7/31/2024	8:21 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.03	1.07	
7/31/2024	8:48 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	□	1.5	1.25	1.2	
7/31/2024	9:02 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.07	1.07	
7/31/2024	9:34 AM	234 Kitchen Faucet (209-04)	2	✓	□	1.5	1.25	1.2	
7/31/2024	10:10 AM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
7/31/2024	10:10 AM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5			0.48
7/31/2024	10:10 AM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
7/31/2024	10:40 AM	126-05 Men-Lavatory Faucet-Left	2	✓	□	0.5			0.48
7/31/2024	10:46 AM	123-05 Health Unit - Sink/Faucet	2	✓	□	0.5			1.11
7/31/2024	10:58 AM	126-05 Men-Lavatory Faucet-Center	2	✓	□	0.5			0.48
7/31/2024	10:58 AM	126-05 Men-Lavatory Faucet-Right	2	✓	□	0.5			0.48
7/31/2024	11:02 AM	123-07 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
7/31/2024	11:14 AM	123-08 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
7/31/2024	11:15 AM	126-06 Shower Room - Shower-North-Left	1	✓	✓	2			1.36
7/31/2024	11:15 AM	126-06 Shower Room-Shower-North-Center	1	✓	✓	2			0.93
7/31/2024	11:15 AM	126-06 Shower Room - Shower-North-Right	1	✓	✓	2			1.57
7/31/2024	11:30 AM	128-01 Lactation Room A-Sink/Faucet	2	✓	□	1.5	1.15	1.15	
7/31/2024	11:40 AM	128-02 Lactation Room B-Sink/Faucet	2	✓	□	1.5	1.2	1.15	
7/31/2024	11:45 AM	126-06 Shower Room - Shower-South-Left	1	✓	✓	2			2.3
7/31/2024	11:45 AM	126-06 Shower Room-Shower-South-Center	1	✓	✓	2			1.85
7/31/2024	11:45 AM	126-06 Shower Room - Shower-South-Right	1	✓	✓	2			1.76
7/31/2024	12:01 PM	128-03 Lactation Room C-Sink/Faucet	2	✓	□	1.5	1.15	1.11	
7/31/2024	1:45 PM	GSA Suite Kitchenette-Sink/Faucet	2	✓	□	1.5	1.25	1.25	
7/31/2024	1:56 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	□	1.5	1.25	1.57	
7/31/2024	2:24 PM	Print, Postal Sorting Area Faucet	2	✓	□		1.61	2.0	
7/31/2024	2:36 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	0.98	0.98	
7/31/2024	2:47 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
7/31/2024	3:09 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
7/31/2024	7:21 PM	128-04 Lactation Room D-Sink/Faucet	2	✓	□	1.5	1.07	1.11	
7/31/2024	9:08 PM	119-02 Mailroom - Faucet	2	✓	□		0.96	0.48	
7/31/2024	9:08 PM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6			
7/31/2024	9:08 PM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6			
7/31/2024	9:08 PM	119-08 Toilet/Sink Combo-Right	2	✓	□	1.6			
7/31/2024	9:08 PM	119-10 Toilet/Sink Combo	2	✓	□	1.6			
7/31/2024	9:08 PM	119-07 Toilet/Sink Combo-Right	2	✓	□	1.6			
7/31/2024	9:08 PM	119-11 Toilet/Sink Combo	2	✓	□	1.6			
7/31/2024	9:08 PM	119-16A Shower	2	✓	□				1.04
7/31/2024	9:08 PM	119-17 Toilet/Sink Combo	2	✓	□	1.6			
7/31/2024	9:08 PM	119-19 Food Storage Room-Sink/Faucet	2	✓	□	1.6	1.04	0.56	
7/31/2024	9:08 PM	119-21 Faucet/Eyewash	2	✓	□		1.04	0.48	

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 07/28/2024 to 08/03/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
7/29/2024	2944136	C207 Janitor's Closet-Mop/Slop Sink
7/30/2024	2944419	Suite. 540 Kitchenette - Faucet
7/31/2024	2944222	Suite 415 Kitchenette - Faucet (N)
7/31/2024	2945144	Suite 435 Kitchenette Faucet (SE) A (Second fixture)
7/31/2024	2944164	Break Room North West - Kitchen Faucet (207-14)
7/31/2024	2944165	Break Room North East Kitchen - Faucet (207-39)
7/31/2024	2944166	Break Room South East Kitchen - Faucet (207-49)
7/31/2024	2944132	126-03 Women-Shower-1st from L to R
7/31/2024	2944133	126-03 Women-Shower-2nd from L to R
7/31/2024	2944134	126-03 Women-Shower-3rd from L to R
7/31/2024	2944135	126-03 Women-Shower-4th from L to R

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 08/04/2024 to 08/10/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
8/5/2024	12:14 AM		2M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:15 AM		2M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:17 AM		2W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:18 AM		2W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:19 AM		2W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:30 AM		2M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:31 AM		2M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:33 AM		2W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:34 AM		2W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:35 AM		2W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:43 AM		C207 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>				
8/5/2024	12:50 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	12:52 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.9		
8/5/2024	12:55 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/5/2024	1:05 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	1:06 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	1:07 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	1:09 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.4	1.4	
8/5/2024	1:10 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.4	1.4	
8/5/2024	1:14 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	1:15 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	1:20 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	1:21 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	1:26 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	2:06 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	2:08 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	2:19 AM		CLL09-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.9		
8/5/2024	2:31 AM		LLM-1 Men-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	2:33 AM		LLM-1 Men-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	2:37 AM		LLW-1 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	2:38 AM		LLW-1 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	3:53 AM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	3:53 AM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	3:56 AM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	3:58 AM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	3:59 AM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:06 AM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:07 AM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:11 AM		6W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:11 AM		6W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:15 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.9		
8/5/2024	4:17 AM		6W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:18 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:20 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:20 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:23 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:23 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:29 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:29 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:31 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:31 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:31 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	4:41 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/5/2024	1:56 PM		3W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	8:30 PM		10M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	8:30 PM		10M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	8:35 PM		10W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	8:37 PM		10W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	8:37 PM		10W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	8:43 PM		10M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	8:45 PM		10M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	8:47 PM		10W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	8:47 PM		10W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/5/2024	8:47 PM		10W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

8/5/2024	8:51 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	8:51 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/5/2024	8:56 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	8:59 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.7		
8/5/2024	9:02 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:02 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:04 PM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/5/2024	9:06 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:08 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:08 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/5/2024	9:08 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:09 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:12 PM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.9		
8/5/2024	9:16 PM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:18 PM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:21 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:21 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:27 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:28 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:30 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/5/2024	9:30 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:30 PM	8W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:39 PM	C807-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
8/5/2024	9:39 PM	7W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:39 PM	7W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/5/2024	9:39 PM	7W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:41 PM	7M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:42 PM	7M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:45 PM	7M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:45 PM	C407 Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
8/5/2024	9:47 PM	7M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:48 PM	7W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:48 PM	7W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/5/2024	9:49 PM	7W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:49 PM	4M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:50 PM	4M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:54 PM	4W-2 Women West-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	9:55 PM	4W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/5/2024	9:56 PM	4W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	9:59 PM	C707-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.8		
8/5/2024	10:10 PM	4M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	10:11 PM	4M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	10:15 PM	4W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	✓	0.5			
8/5/2024	10:16 PM	4W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	✓	0.5			
8/5/2024	10:17 PM	4W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	✓	0.5			
8/5/2024	10:38 PM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	10:39 PM	3W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/5/2024	10:40 PM	3W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	10:47 PM	3M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	10:48 PM	3M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	10:54 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/5/2024	10:57 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/5/2024	10:58 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/5/2024	11:21 PM	E201 Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
8/6/2024	9:03 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.25	1.25	
8/6/2024	9:33 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.36	1.3	
8/6/2024	10:19 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.11	1.07	
8/6/2024	10:36 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.11	1.11	
8/6/2024	10:51 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.11	1.03	
8/6/2024	11:23 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.2	1.25	
8/6/2024	11:46 AM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.2	1.25	
8/6/2024	2:38 PM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.25	1.2	
8/6/2024	2:55 PM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.11	1.15	
8/6/2024	3:09 PM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	□	1.5	1.36	1.3	
8/6/2024	3:26 PM	Suite 1015 GSA Kitchenette Faucet (1000-03)	2	✓	□	1.5	1.2	1.15	
8/6/2024	3:41 PM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.36	1.3	
8/6/2024	3:53 PM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
8/6/2024	4:08 PM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.15	1.2	
8/6/2024	4:08 PM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.15	1.2	
8/6/2024	4:58 PM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.03	1.03	
8/6/2024	4:58 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1.03	1.03	
8/6/2024	5:18 PM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5	1.25	1.2	
8/6/2024	5:27 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.07	1.11	
8/6/2024	5:27 PM	540 Faucet (507-26)	2	✓	□	1.5	1.07	1.11	

8/6/2024	5:37 PM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.2	1.25	
8/6/2024	5:48 PM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	□	1.5	1.15	1.07	
8/6/2024	5:59 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.2	1.2	
8/6/2024	5:59 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.2	1.2	
8/6/2024	6:10 PM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.25	1.25	
8/6/2024	6:10 PM	Suite 532 Lactation Room - Faucet	2	✓	□	1.5	1.25	1.25	
8/6/2024	6:29 PM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.5	1.15	1.2	
8/6/2024	6:29 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.15	1.2	
8/7/2024	8:33 AM	119-02 Mailroom - Faucet	2	✓	□		2.2	2.2	
8/7/2024	8:45 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.2	1.2	
8/7/2024	8:45 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5			0.24
8/7/2024	8:55 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.3	1.3	
8/7/2024	9:05 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.2	1.2	
8/7/2024	9:15 AM	Suite 415 Kitchenette - Faucet (N)	2	✓	□	1.5	1.4	1.4	
8/7/2024	9:25 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	□	1.5	1.2	1.2	
8/7/2024	9:35 AM	234 Kitchen Faucet (209-04)	2	✓	□	1.5	1.2	1.2	
8/7/2024	9:45 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	□	1.5	1.2	1.2	
8/7/2024	9:55 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	□	1.5	1.3	1.3	
8/7/2024	10:05 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	□	1.5	1.2	1.2	
8/7/2024	10:45 AM	GSA Suite Kitchenette-Sink/Faucet	2	✓	□	1.5	1.2	1.2	
8/7/2024	1:20 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	✓	1.5	1.4	1.0	
8/7/2024	7:33 PM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/7/2024	7:38 PM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/7/2024	7:39 PM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/7/2024	7:54 PM	126-03 Women-Shower-1st from L to R	1	✓	□	2			1.6
8/7/2024	7:58 PM	126-03 Women-Shower-2nd from L to R	1	✓	□	2			1.6
8/7/2024	8:00 PM	126-03 Women-Shower-3rd from L to R	1	✓	□	2			2
8/7/2024	8:03 PM	126-03 Women-Shower-4th from L to R	1	✓	□	2			1.7
8/7/2024	8:09 PM	126-05 Men-Lavatory Faucet-Left	2	✓	□	0.5			0.48
8/7/2024	8:11 PM	126-05 Men-Lavatory Faucet-Center	2	✓	□	0.5			0.48
8/7/2024	8:11 PM	126-05 Men-Lavatory Faucet-Right	2	✓	□	0.5			0.48
8/7/2024	8:17 PM	126-06 Shower Room - Shower-South-Right	1	✓	□	2			0.24
8/7/2024	8:21 PM	126-06 Shower Room - Shower-North-Right	1	✓	□	2			4.4
8/7/2024	8:21 PM	126-06 Shower Room-Shower-South-Center	1	✓	□	2			2.2
8/7/2024	8:24 PM	126-06 Shower Room - Shower-South-Left	1	✓	□	2			4.9
8/7/2024	8:29 PM	126-06 Shower Room-Shower-North-Center	1	✓	□	2			4
8/7/2024	8:32 PM	126-06 Shower Room - Shower-North-Left	1	✓	□	2			4
8/7/2024	8:39 PM	119-19 Food Storage Room-Sink/Faucet	2	✓	□	1.6	1.96	0.88	
8/7/2024	8:46 PM	119-21 Faucet/Eyewash	2	✓	□		1.4	0.88	
8/7/2024	8:48 PM	119-16A Shower	2	✓	□				0.42
8/7/2024	8:56 PM	119-11 Toilet/Sink Combo	2	✓	□	1.6			
8/7/2024	9:07 PM	119-10 Toilet/Sink Combo	2	✓	□	1.6			
8/7/2024	9:10 PM	119-07 Toilet/Sink Combo-Right	2	✓	□	1.6			
8/7/2024	9:12 PM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6			
8/7/2024	9:15 PM	119-08 Toilet/Sink Combo-Right	2	✓	□	1.6			
8/7/2024	9:21 PM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6			
8/7/2024	10:20 PM	123-05 Health Unit - Sink/Faucet	2	✓	□	0.5			1.3
8/7/2024	10:25 PM	123-07 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.49
8/7/2024	10:35 PM	123-08 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
8/7/2024	10:55 PM	128-01 Lactation Room A-Sink/Faucet	2	✓	□	1.5	1.2	1.2	
8/7/2024	11:00 PM	128-02 Lactation Room B-Sink/Faucet	2	✓	□	1.5	1.2	1.2	
8/7/2024	11:05 PM	128-03 Lactation Room C-Sink/Faucet	2	✓	□	1.5	1.3	1.3	
8/7/2024	11:10 PM	128-04 Lactation Room D-Sink/Faucet	2	✓	□	1.5	1.2	1.3	
8/7/2024	11:25 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
8/7/2024	11:30 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
8/7/2024	11:35 PM	Print, Postal Sorting Area Faucet	2	✓	□		1.8	1.7	
8/7/2024	11:45 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	1.3	1.2	

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 08/04/2024 to 08/10/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
8/6/2024	2944419	Suite. 540 Kitchenette - Faucet
8/7/2024	2944088	119-17 Toilet/Sink Combo

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 08/11/2024 to 08/17/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
8/12/2024	12:00 AM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:06 AM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.36
8/12/2024	12:07 AM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.4
8/12/2024	12:09 AM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:10 AM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:11 AM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:20 AM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/12/2024	12:24 AM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:25 AM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:26 AM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:35 AM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:36 AM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:41 AM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:42 AM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:44 AM		6W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:45 AM		6W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:46 AM		6W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:57 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
8/12/2024	2:05 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:06 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:07 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:15 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:16 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:21 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/12/2024	2:24 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:25 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:26 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:28 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:29 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:18 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:18 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:31 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:31 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:50 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:59 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
8/12/2024	4:11 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:11 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:12 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:15 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:19 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:19 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:25 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.68	1.21	
8/12/2024	4:32 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.67	1.22	
8/12/2024	4:40 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
8/12/2024	5:02 AM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:29 PM		Suite 1015 GSA Kitchenette Faucet (1000-03)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.11	1.07	
8/12/2024	4:25 PM		CLL09-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/12/2024	8:28 PM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:28 PM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:35 PM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:37 PM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:37 PM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:41 PM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:42 PM		C407 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
8/12/2024	8:46 PM		4W-2 Women West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:46 PM		4W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:46 PM		4W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:48 PM		4M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:51 PM		3W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:52 PM		3W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:52 PM		3W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:56 PM		3M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:56 PM		3M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	9:04 PM		3M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

8/12/2024	9:12 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:13 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:19 PM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:21 PM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:21 PM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	9:22 PM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:22 PM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:25 PM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:26 PM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:28 PM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:28 PM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	9:28 PM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:39 PM	LLM-1 Men-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:40 PM	LLM-1 Men-Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:40 PM	LLW-1 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:40 PM	LLW-1 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:48 PM	10M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:49 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:53 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	9:54 PM	10W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:55 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:02 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:03 PM	10M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:07 PM	10W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	10:08 PM	10W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:09 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:17 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
8/12/2024	10:21 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:22 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	10:23 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:30 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:31 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:39 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:40 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:42 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:43 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	10:44 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:52 PM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.7		
8/12/2024	10:56 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:57 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	11:01 PM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	11:02 PM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	11:03 PM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	11:09 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	11:10 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	11:13 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	11:14 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	11:15 PM	8W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	11:22 PM	C807-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
8/12/2024	11:22 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	11:24 PM	7W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	11:25 PM	7W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	11:26 PM	7W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	11:59 PM	7M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			2.3
8/13/2024	8:28 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.2	1.25	
8/13/2024	8:46 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.36	1.36	
8/13/2024	8:46 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5		0.75	
8/13/2024	9:16 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.36	1.3	
8/13/2024	9:26 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.25	1.25	
8/13/2024	9:48 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.2	1.15	
8/13/2024	10:01 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.3	1.36	
8/13/2024	10:15 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.15	1.11	
8/13/2024	10:32 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.15	1.11	
8/13/2024	10:54 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.25	1.25	
8/13/2024	11:08 AM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.30	1.36	
8/13/2024	2:13 PM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.15	1.15	
8/13/2024	2:35 PM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
8/13/2024	2:38 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1.15	1.07	
8/13/2024	3:20 PM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.20	1.25	
8/13/2024	4:25 PM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.5	1.2	1.2	
8/13/2024	4:36 PM	540 Faucet (507-26)	2	✓	□	1.5	1.03	1.11	
8/13/2024	4:49 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.25	1.2	
8/13/2024	5:01 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.2	1.2	
8/13/2024	5:11 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.3	1.25	

8/13/2024	5:46 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.11	1.11	
8/14/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.2	1.2	
8/14/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5		1.2	
8/14/2024	8:40 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.3	1.3	
8/14/2024	8:50 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.3	1.3	
8/14/2024	9:00 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	□	1.5	1.2	1.2	
8/14/2024	9:25 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	□	1.5	1.3	1.3	
8/14/2024	9:35 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	□	1.5	1.3	1.5	
8/14/2024	9:45 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	□	1.5	1.2	1.2	
8/14/2024	10:12 AM	234 Kitchen Faucet (209-04)	2	✓	□	1.5	1.25	1.25	
8/14/2024	11:00 AM	123-05 Health Unit - Sink/Faucet	2	✓	□	0.5			1.20
8/14/2024	11:15 AM	123-07 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
8/14/2024	11:30 AM	123-08 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
8/14/2024	1:27 PM	128-01 Lactation Room A-Sink/Faucet	2	✓	□	1.5	1.07	1.07	
8/14/2024	1:37 PM	128-02 Lactation Room B-Sink/Faucet	2	✓	□	1.5	1.15	1.15	
8/14/2024	1:58 PM	128-03 Lactation Room C-Sink/Faucet	2	✓	□	1.5	1.11	1.15	
8/14/2024	2:06 PM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/14/2024	2:07 PM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/14/2024	2:08 PM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/14/2024	2:12 PM	126-03 Women-Shower-1st from L to R	1	✓	□	2			0.48
8/14/2024	2:12 PM	128-04 Lactation Room D-Sink/Faucet	2	✓	□	1.5	1.11	1.03	
8/14/2024	2:15 PM	126-03 Women-Shower-2nd from L to R	1	✓	□	2			0.48
8/14/2024	2:15 PM	Print, Postal Sorting Area Faucet	2	✓	□		2.00	1.4	
8/14/2024	2:17 PM	126-03 Women-Shower-3rd from L to R	1	✓	□	2			0.48
8/14/2024	2:19 PM	126-03 Women-Shower-4th from L to R	1	✓	□	2			0.48
8/14/2024	2:24 PM	126-05 Men-Lavatory Faucet-Left	2	✓	□	0.5			0.48
8/14/2024	2:25 PM	126-05 Men-Lavatory Faucet-Center	2	✓	□	0.5			0.48
8/14/2024	2:26 PM	126-05 Men-Lavatory Faucet-Right	2	✓	□	0.5			0.48
8/14/2024	2:27 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	1.11	1.00	
8/14/2024	2:32 PM	126-06 Shower Room - Shower-North-Left	1	✓	□	2			0.75
8/14/2024	2:33 PM	126-06 Shower Room-Shower-North-Center	1	✓	□	2			0.75
8/14/2024	2:34 PM	126-06 Shower Room - Shower-North-Right	1	✓	□	2			0.75
8/14/2024	2:35 PM	126-06 Shower Room - Shower-South-Left	1	✓	□	2			0.75
8/14/2024	2:36 PM	126-06 Shower Room-Shower-South-Center	1	✓	□	2			0.75
8/14/2024	2:37 PM	126-06 Shower Room - Shower-South-Right	1	✓	□	2			0.75
8/14/2024	2:37 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
8/14/2024	2:57 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
8/14/2024	3:29 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	□	1.5	1.87	1.57	
8/14/2024	3:40 PM	GSA Suite Kitchenette-Sink/Faucet	2	✓	□	1.5	1.87	1.87	
8/14/2024	11:07 PM	119-02 Mailroom - Faucet	2	✓	✓		1.8	1.2	
8/14/2024	11:07 PM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6			
8/14/2024	11:07 PM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6			
8/14/2024	11:07 PM	119-08 Toilet/Sink Combo-Right	2	✓	□	1.6			
8/14/2024	11:07 PM	119-10 Toilet/Sink Combo	2	✓	□	1.6			
8/14/2024	11:07 PM	119-07 Toilet/Sink Combo-Right	2	✓	□	1.6			
8/14/2024	11:07 PM	119-11 Toilet/Sink Combo	2	✓	□	1.6			
8/14/2024	11:07 PM	119-16A Shower	2	✓	□				1.4
8/14/2024	11:07 PM	119-17 Toilet/Sink Combo	2	✓	□	1.6			
8/14/2024	11:07 PM	119-19 Food Storage Room-Sink/Faucet	2	✓	✓	1.6	1.8	1.3	
8/14/2024	11:07 PM	119-21 Faucet/Eyewash	2	✓	✓		1.8	1.6	


**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 08/11/2024 to 08/17/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
8/12/2024	2944136	C207 Janitor's Closet-Mop/Slop Sink
8/13/2024	2944419	Suite. 540 Kitchenette - Faucet
8/13/2024	2944278	Suite 615 Break Room-Kitchen Faucet (607-06)
8/13/2024	2945143	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)
8/13/2024	2944411	Suite 1008 Break Room-Kitchen Faucet (1009-07)
8/13/2024	2944409	Suite 1009C Break Room-Kitchen Faucet (1009-19)
8/13/2024	2944259	Suite 530 Kitchenette - Faucet (509-10)
8/13/2024	2944418	Suite 532 Lactation Room - Faucet
8/14/2024	2944222	Suite 415 Kitchenette - Faucet (N)

### Pre & Post Flush Chlorine Levels

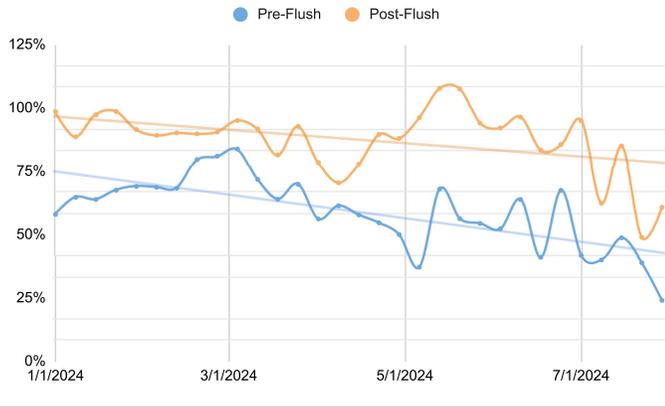

Results by Week						
Week Starting	Pre-Flush Tests (#)	Pre-Flush Good (#)	Pre-Flush Good (%)	Post-Flush Tests (#)	Post-Flush Good (#)	Post-Flush Good (%)
11/6/2023	85	55	64.71%	83	81	97.59%
11/13/2023	112	83	74.11%	108	103	95.37%
11/20/2023	81	44	54.32%	76	72	94.74%
11/27/2023	84	45	53.57%	80	80	100.00%
12/4/2023	77	42	54.55%	71	71	100.00%
12/11/2023	86	60	69.77%	80	75	93.75%
12/18/2023	71	33	46.48%	71	64	90.14%
12/25/2023	75	41	54.67%	75	69	92.00%
1/1/2024	69	40	57.97%	68	67	98.53%
1/8/2024	85	55	64.71%	79	70	88.61%
1/15/2024	83	53	63.86%	73	71	97.26%
1/22/2024	80	54	67.50%	70	69	98.57%
1/29/2024	84	58	69.05%	82	75	91.46%
2/5/2024	83	57	68.67%	83	74	89.16%
2/12/2024	82	56	68.29%	81	73	90.12%
2/19/2024	88	70	79.55%	88	79	89.77%
2/26/2024	84	68	80.95%	84	76	90.48%
3/4/2024	80	67	83.75%	80	76	95.00%
3/11/2024	85	61	71.76%	84	77	91.67%
3/18/2024	86	55	63.95%	86	70	81.40%
3/25/2024	83	58	69.88%	82	76	92.68%
4/1/2024	89	50	56.18%	88	69	78.41%
4/8/2024	88	54	61.36%	88	62	70.45%
4/15/2024	90	52	57.78%	90	70	77.78%
4/22/2024	86	47	54.65%	86	77	89.53%
4/29/2024	84	42	50.00%	83	73	87.95%
5/6/2024	78	29	37.18%	78	75	96.15%
5/13/2024	78	53	67.95%	78	84	107.69%
5/20/2024	80	45	56.25%	80	86	107.50%
5/27/2024	68	37	54.41%	66	62	93.94%
6/3/2024	88	46	52.27%	88	81	92.05%
6/10/2024	83	53	63.86%	82	79	96.34%
6/17/2024	78	32	41.03%	78	65	83.33%
6/24/2024	83	56	67.47%	83	71	85.54%
7/1/2024	79	33	41.77%	78	74	94.87%
7/8/2024	85	34	40.00%	85	53	62.35%
7/15/2024	80	39	48.75%	80	68	85.00%
7/22/2024	90	35	38.89%	90	44	48.89%
7/29/2024	79	19	24.05%	79	48	60.76%
8/5/2024	85	23	27.06%	85	48	56.47%
8/12/2024	74	17	22.97%	74	43	58.11%
8/19/2024	85	38	44.71%	84	55	65.48%
8/26/2024	77	27	35.06%	77	76	98.70%
9/2/2024			#DIV/0!			#DIV/0!
9/9/2024			#DIV/0!			#DIV/0!
9/16/2024						

Results by Week by Floor							All
Week Starting	Pre-Flush Tests (#)	Pre-Flush Good (#)	Pre-Flush Good (%)	Post-Flush Tests (#)	Post-Flush Good (#)	Post-Flush Good (%)	
11/6/2023	85	55	64.71%	83	81	97.59%	97.59%
11/13/2023	112	83	74.11%	108	103	95.37%	95.37%
11/20/2023	81	44	54.32%	76	72	94.74%	94.74%
11/27/2023	84	45	53.57%	80	80	100.00%	100.00%
12/4/2023	77	42	54.55%	71	71	100.00%	100.00%
12/11/2023	86	60	69.77%	80	75	93.75%	93.75%
12/18/2023	71	33	46.48%	71	64	90.14%	90.14%
12/25/2023	75	41	54.67%	75	69	92.00%	92.00%
1/1/2024	69	40	57.97%	68	67	98.53%	98.53%
1/8/2024	85	55	64.71%	79	70	88.61%	88.61%
1/15/2024	83	53	63.86%	73	71	97.26%	97.26%
1/22/2024	80	54	67.50%	70	69	98.57%	98.57%
1/29/2024	84	58	69.05%	82	75	91.46%	91.46%
2/5/2024	83	57	68.67%	83	74	89.16%	89.16%
2/12/2024	82	56	68.29%	81	73	90.12%	90.12%
2/19/2024	88	70	79.55%	88	79	89.77%	89.77%
2/26/2024	84	68	80.95%	84	76	90.48%	90.48%
3/4/2024	80	67	83.75%	80	76	95.00%	95.00%
3/11/2024	85	61	71.76%	84	77	91.67%	91.67%
3/18/2024	86	55	63.95%	86	70	81.40%	81.40%
3/25/2024	83	58	69.88%	82	76	92.68%	92.68%
4/1/2024	89	50	56.18%	88	69	78.41%	78.41%
4/8/2024	88	54	61.36%	88	62	70.45%	70.45%
4/15/2024	90	52	57.78%	90	70	77.78%	77.78%
4/22/2024	86	47	54.65%	86	77	89.53%	89.53%
4/29/2024	84	42	50.00%	83	73	87.95%	87.95%
5/6/2024	78	29	37.18%	78	75	96.15%	96.15%
5/13/2024	78	53	67.95%	78	84	107.69%	107.69%
5/20/2024	80	45	56.25%	80	86	107.50%	107.50%
5/27/2024	68	37	54.41%	66	62	93.94%	93.94%
6/3/2024	88	46	52.27%	88	81	92.05%	92.05%
6/10/2024	83	53	63.86%	82	79	96.34%	96.34%
6/17/2024	78	32	41.03%	78	65	83.33%	83.33%
6/24/2024	83	56	67.47%	83	71	85.54%	85.54%
7/1/2024	79	33	41.77%	78	74	94.87%	94.87%
7/8/2024	85	34	40.00%	85	53	62.35%	62.35%
7/15/2024	80	39	48.75%	80	68	85.00%	85.00%
7/22/2024	90	35	38.89%	90	44	48.89%	48.89%
7/29/2024	79	19	24.05%	79	48	60.76%	60.76%
8/5/2024	85	23	27.06%	85	48	56.47%	56.47%
8/12/2024	74	17	22.97%	74	43	58.11%	58.11%
8/19/2024	85	38	44.71%	84	55	65.48%	65.48%
8/26/2024	77	27	35.06%	77	76	98.70%	98.70%
9/2/2024							
9/9/2024							
9/16/2024							

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 08/11/2024 to 08/17/2024

From: 8/11/2024  
To: 8/17/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing

**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
8/12/2024	12:00 AM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:06 AM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.36
8/12/2024	12:07 AM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.4
8/12/2024	12:09 AM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:10 AM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:11 AM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:20 AM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/12/2024	12:24 AM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:25 AM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:26 AM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:35 AM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:36 AM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:41 AM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:42 AM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:44 AM		6W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:45 AM		6W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:46 AM		6W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:57 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
8/12/2024	2:05 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:06 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:07 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:15 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:16 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:21 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/12/2024	2:24 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:25 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:26 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:28 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	2:29 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:18 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:18 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:31 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:31 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:50 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	3:59 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
8/12/2024	4:11 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:11 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:12 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:15 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:19 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:19 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	4:25 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.68	1.21	
8/12/2024	4:32 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.67	1.22	
8/12/2024	4:40 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
8/12/2024	5:02 AM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	12:29 PM		Suite 1015 GSA Kitchenette Faucet (1000-03)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.11	1.07	
8/12/2024	4:25 PM		CLL09-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/12/2024	8:28 PM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:28 PM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:35 PM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:37 PM		4W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:37 PM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:41 PM		4M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:42 PM		C407 Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
8/12/2024	8:46 PM		4W-2 Women West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:46 PM		4W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:46 PM		4W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:48 PM		4M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:51 PM		3W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:52 PM		3W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:52 PM		3W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/12/2024	8:56 PM		3M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48

8/12/2024	8:56 PM	3M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:04 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:12 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:13 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:19 PM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:21 PM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:21 PM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	9:22 PM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:22 PM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:25 PM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:26 PM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:28 PM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:28 PM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	9:28 PM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:39 PM	LLM-1 Men-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:40 PM	LLM-1 Men-Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:40 PM	LLW-1 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:40 PM	LLW-1 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:48 PM	10M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:49 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	9:53 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	9:54 PM	10W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	9:55 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:02 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:03 PM	10M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:07 PM	10W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	10:08 PM	10W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:09 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:17 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
8/12/2024	10:21 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:22 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	10:23 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:30 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:31 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:39 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:40 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:42 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	10:43 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	10:44 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:52 PM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.7		
8/12/2024	10:56 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	10:57 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	11:01 PM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	11:02 PM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	11:03 PM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	11:09 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	11:10 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	11:13 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	11:14 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	11:15 PM	8W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	11:22 PM	C807-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
8/12/2024	11:22 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	11:24 PM	7W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/12/2024	11:25 PM	7W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/12/2024	11:26 PM	7W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/12/2024	11:59 PM	7M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			2.3
8/13/2024	8:28 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.2	1.25	
8/13/2024	8:46 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.36	1.36	
8/13/2024	8:46 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5		0.75	
8/13/2024	9:16 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	1.36	1.3	
8/13/2024	9:26 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.25	1.25	
8/13/2024	9:48 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.2	1.15	
8/13/2024	10:01 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.3	1.36	
8/13/2024	10:15 AM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.15	1.11	
8/13/2024	10:32 AM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.15	1.11	
8/13/2024	10:54 AM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.25	1.25	
8/13/2024	11:08 AM	Suite 910A Faucet (910-05)	2	✓	□	1.5	1.30	1.36	
8/13/2024	2:13 PM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.15	1.15	
8/13/2024	2:35 PM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
8/13/2024	2:38 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1.15	1.07	
8/13/2024	3:20 PM	Suite 1010 Kitchenette Faucet	2	✓	□	1.5	1.20	1.25	
8/13/2024	4:25 PM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.5	1.2	1.2	
8/13/2024	4:36 PM	540 Faucet (507-26)	2	✓	□	1.5	1.03	1.11	
8/13/2024	4:49 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.5	1.25	1.2	

8/13/2024	5:01 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	□	1.5	1.2	1.2	
8/13/2024	5:11 PM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.3	1.25	
8/13/2024	5:46 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.11	1.11	
8/14/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE)	2	✓	□	1.5	1.2	1.2	
8/14/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	✓	□	1.5			1.2
8/14/2024	8:40 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	✓	□	1.5	1.3	1.3	
8/14/2024	8:50 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	✓	□	1.5	1.3	1.3	
8/14/2024	9:00 AM	Suite 410 Kitchenette Faucet (NW)	2	✓	□	1.5	1.2	1.2	
8/14/2024	9:25 AM	Break Room North West - Kitchen Faucet (207-14)	2	✓	□	1.5	1.3	1.3	
8/14/2024	9:35 AM	Break Room North East Kitchen - Faucet (207-39)	2	✓	□	1.5	1.3	1.5	
8/14/2024	9:45 AM	Break Room South East Kitchen - Faucet (207-49)	2	✓	□	1.5	1.2	1.2	
8/14/2024	10:12 AM	234 Kitchen Faucet (209-04)	2	✓	□	1.5	1.25	1.25	
8/14/2024	11:00 AM	123-05 Health Unit - Sink/Faucet	2	✓	□	0.5			1.20
8/14/2024	11:15 AM	123-07 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
8/14/2024	11:30 AM	123-08 Health Unit-Lavatory Faucet	2	✓	□	0.5			0.48
8/14/2024	1:27 PM	128-01 Lactation Room A-Sink/Faucet	2	✓	□	1.5	1.07	1.07	
8/14/2024	1:37 PM	128-02 Lactation Room B-Sink/Faucet	2	✓	□	1.5	1.15	1.15	
8/14/2024	1:58 PM	128-03 Lactation Room C-Sink/Faucet	2	✓	□	1.5	1.11	1.15	
8/14/2024	2:06 PM	126-02 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/14/2024	2:07 PM	126-02 Women-Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/14/2024	2:08 PM	126-02 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/14/2024	2:12 PM	126-03 Women-Shower-1st from L to R	1	✓	□	2			0.48
8/14/2024	2:12 PM	128-04 Lactation Room D-Sink/Faucet	2	✓	□	1.5	1.11	1.03	
8/14/2024	2:15 PM	126-03 Women-Shower-2nd from L to R	1	✓	□	2			0.48
8/14/2024	2:15 PM	Print, Postal Sorting Area Faucet	2	✓	□		2.00	1.4	
8/14/2024	2:17 PM	126-03 Women-Shower-3rd from L to R	1	✓	□	2			0.48
8/14/2024	2:19 PM	126-03 Women-Shower-4th from L to R	1	✓	□	2			0.48
8/14/2024	2:24 PM	126-05 Men-Lavatory Faucet-Left	2	✓	□	0.5			0.48
8/14/2024	2:25 PM	126-05 Men-Lavatory Faucet-Center	2	✓	□	0.5			0.48
8/14/2024	2:26 PM	126-05 Men-Lavatory Faucet-Right	2	✓	□	0.5			0.48
8/14/2024	2:27 PM	LL15 Break Room-Kitchen Faucet	2	✓	□	1.5	1.11	1.00	
8/14/2024	2:32 PM	126-06 Shower Room - Shower-North-Left	1	✓	□	2			0.75
8/14/2024	2:33 PM	126-06 Shower Room-Shower-North-Center	1	✓	□	2			0.75
8/14/2024	2:34 PM	126-06 Shower Room - Shower-North-Right	1	✓	□	2			0.75
8/14/2024	2:35 PM	126-06 Shower Room - Shower-South-Left	1	✓	□	2			0.75
8/14/2024	2:36 PM	126-06 Shower Room-Shower-South-Center	1	✓	□	2			0.75
8/14/2024	2:37 PM	126-06 Shower Room - Shower-South-Right	1	✓	□	2			0.75
8/14/2024	2:37 PM	LL15 Men's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
8/14/2024	2:57 PM	LL15 Women's Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
8/14/2024	3:29 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	✓	□	1.5	1.87	1.57	
8/14/2024	3:40 PM	GSA Suite Kitchenette-Sink/Faucet	2	✓	□	1.5	1.87	1.87	
8/14/2024	11:07 PM	119-02 Mailroom - Faucet	2	✓	✓		1.8	1.2	
8/14/2024	11:07 PM	119-07 Toilet/Sink Combo-Left	2	✓	□	1.6			
8/14/2024	11:07 PM	119-08 Toilet/Sink Combo-Left	2	✓	□	1.6			
8/14/2024	11:07 PM	119-08 Toilet/Sink Combo-Right	2	✓	□	1.6			
8/14/2024	11:07 PM	119-10 Toilet/Sink Combo	2	✓	□	1.6			
8/14/2024	11:07 PM	119-07 Toilet/Sink Combo-Right	2	✓	□	1.6			
8/14/2024	11:07 PM	119-11 Toilet/Sink Combo	2	✓	□	1.6			
8/14/2024	11:07 PM	119-16A Shower	2	✓	□				1.4
8/14/2024	11:07 PM	119-17 Toilet/Sink Combo	2	✓	□	1.6			
8/14/2024	11:07 PM	119-19 Food Storage Room-Sink/Faucet	2	✓	✓	1.6	1.8	1.3	
8/14/2024	11:07 PM	119-21 Faucet/Eyewash	2	✓	✓		1.8	1.6	

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 08/11/2024 to 08/17/2024**

There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.

**Outlets w/Filters that are not included in the log**

Planned Date	Asset Number	Publication Description
8/12/2024	2944136	C207 Janitor's Closet-Mop/Slop Sink
8/13/2024	2944419	Suite. 540 Kitchenette - Faucet
8/13/2024	2944278	Suite 615 Break Room-Kitchen Faucet (607-06)
8/13/2024	2945143	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)
8/13/2024	2944411	Suite 1008 Break Room-Kitchen Faucet (1009-07)
8/13/2024	2944409	Suite 1009C Break Room-Kitchen Faucet (1009-19)
8/13/2024	2944259	Suite 530 Kitchenette - Faucet (509-10)
8/13/2024	2944418	Suite 532 Lactation Room - Faucet
8/14/2024	2944222	Suite 415 Kitchenette - Faucet (N)

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 08/18/2024 to 08/24/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.

Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
8/19/2024	1:34 AM		2M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	1:35 AM		2M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	1:38 AM		2W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	1:39 AM		2W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	1:40 AM		2W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	1:52 AM		2M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	1:53 AM		2M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	1:56 AM		2W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	1:57 AM		2W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	1:58 AM		2W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	2:20 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	2:24 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
8/19/2024	2:37 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.9		
8/19/2024	2:43 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	2:44 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	2:45 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	2:53 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	2:54 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	2:55 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	4:12 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	4:13 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	4:17 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	4:18 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	4:19 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.2	
8/19/2024	4:20 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.3	
8/19/2024	4:33 AM		CLL09-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
8/19/2024	4:43 AM		LLM-1 Men-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	4:44 AM		LLM-1 Men-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	4:50 AM		LLW-1 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	4:51 AM		LLW-1 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	5:00 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.5		
8/19/2024	5:07 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	5:07 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	5:07 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	5:10 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	5:10 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	5:14 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	5:16 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	5:16 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	5:16 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	5:22 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
8/19/2024	5:22 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:08 AM		10M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:08 AM		10M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:20 AM		10W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:21 AM		10W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:34 AM		10M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:35 AM		10M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:35 AM		10W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:40 AM		10W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:40 AM		10W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:40 AM		C1007-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/19/2024	11:41 AM		10W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:50 AM		9W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:50 AM		9W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:50 AM		9W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:52 AM		9M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:52 AM		9M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:54 AM		9M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:55 AM		9M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:57 AM		9W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:57 AM		9W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:57 AM		9W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/19/2024	11:57 AM		C907-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		

8/19/2024	11:58 AM	8W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/19/2024	11:58 AM	8W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	11:58 AM	8W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	12:00 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	12:00 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	12:05 PM	8M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	12:05 PM	8M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	12:05 PM	8W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/19/2024	12:05 PM	8W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	12:05 PM	8W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	12:09 PM	C807-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.7		
8/19/2024	12:09 PM	7W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	12:09 PM	7W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/19/2024	12:09 PM	7W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	12:09 PM	7M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	12:09 PM	7M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	12:28 PM	7M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	12:28 PM	7M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	12:28 PM	7W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	12:29 PM	7W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/19/2024	12:29 PM	7W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	12:35 PM	C707-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.8		
8/19/2024	4:36 PM	6M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	4:36 PM	6M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	4:48 PM	6W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	4:48 PM	6W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/19/2024	4:48 PM	6W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	4:55 PM	6M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	4:58 PM	6M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	4:58 PM	6W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	4:58 PM	6W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/19/2024	4:58 PM	6W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	10:10 PM	C407 Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
8/19/2024	10:14 PM	4M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	10:15 PM	4M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	10:17 PM	4W-2 Women West-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	10:18 PM	4W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/19/2024	10:19 PM	4W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	10:34 PM	4W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			2.3
8/19/2024	10:35 PM	4W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			2.8
8/19/2024	10:36 PM	4W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			2.9
8/19/2024	10:47 PM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	10:48 PM	3W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/19/2024	10:49 PM	3W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	10:58 PM	3M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	10:59 PM	3M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	11:03 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	11:07 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	11:08 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/19/2024	11:09 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/19/2024	11:26 PM	E201 Restroom - Lavatory Faucet	1	✓	□	0.5			0.48
8/19/2024	10:31 PM	4M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/19/2024	10:32 PM	4M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/20/2024	8:28 AM	Suite 615 Break Room-Kitchen Faucet (607-06)	2	✓	□	1.5	1.07	1.11	
8/20/2024	8:28 AM	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)	2	✓	□	1.5		0.81	
8/20/2024	8:52 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.25	1.25	
8/20/2024	9:13 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.50	1.36	1.30	
8/20/2024	9:54 AM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	□	1.5	1.11	1.07	
8/20/2024	10:18 AM	540 Faucet (507-26)	2	✓	□	1.5	1.07	1.03	
8/20/2024	10:29 AM	540 Faucet (507-26) A (Second fixture)	2	✓	□	1.50	1.25	1.25	
8/20/2024	10:40 AM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	□	1.50	1.20	1.20	
8/20/2024	10:52 AM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	✓	✓	1.50	1.20	1.20	
8/20/2024	11:06 AM	Suite 540 Training Lobby - Faucet (507-12)	2	✓	□	1.5	1.2	1.25	
8/20/2024	11:20 AM	Suite 532 Lactation Room - Faucet	2	✓	□	1.5	1.25	1.25	
8/20/2024	11:34 AM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	□	1.5	1.2	1.15	
8/20/2024	3:10 PM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.15	1.15	
8/20/2024	3:22 PM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.36	1.3	
8/20/2024	3:33 PM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.25	1.2	
8/20/2024	3:58 PM	Suite 808A Break Room Faucet (809-02)	1	✓	□	1.5	1.15	1.2	
8/20/2024	4:09 PM	Suite 810 Kitchen Faucet	1	✓	□	1.5	1.20	1.25	
8/20/2024	4:20 PM	Suite 908 Break Room Faucet (908-15)	2	✓	□	1.5	1.20	1.2	
8/20/2024	4:33 PM	Suite 907A Break Room Faucet (907-22)	2	✓	□	1.5	1.30	1.3	
8/20/2024	4:46 PM	Suite 520 Kitchenette Faucet (508-13)	2	✓	□	1.5	1.20	1.15	
8/20/2024	4:57 PM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	□	1.5	1.30	1.25	

8/20/2024	5:09 PM	Suite 910A Faucet (910-05)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.25	1.5	
8/20/2024	5:22 PM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.25	1.25	
8/21/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
8/21/2024	8:30 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5			1.24
8/21/2024	8:40 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.3	
8/21/2024	8:50 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.3	
8/21/2024	9:00 AM	Suite 410 Kitchenette Faucet (NW)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
8/21/2024	9:00 AM	234 Kitchen Faucet (209-04)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.50	1.30	1.20	
8/21/2024	9:04 AM	119-02 Mailroom - Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		0.76	1.00	
8/21/2024	9:18 AM	119-19 Food Storage Room-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6	0.64	0.08	
8/21/2024	9:25 AM	Break Room North West - Kitchen Faucet (207-14)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.50	1.30	1.30	
8/21/2024	9:35 AM	Break Room North East Kitchen - Faucet (207-39)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.50	1.50	1.50	
8/21/2024	9:45 AM	Break Room South East Kitchen - Faucet (207-49)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.50	1.20	1.20	
8/21/2024	9:45 AM	119-21 Faucet/Eyewash	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		0.68	0.68	
8/21/2024	9:55 AM	123-05 Health Unit - Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.3
8/21/2024	9:56 AM	119-07 Toilet/Sink Combo-Left	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
8/21/2024	10:00 AM	123-07 Health Unit-Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/21/2024	10:10 AM	123-08 Health Unit-Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/21/2024	10:25 AM	GSA Suite Kitchenette-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.50	1.20	1.20	
8/21/2024	10:30 AM	113-6 JLL Kitchenette-Kitchen Faucet	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.50	1.40	1.00	
8/21/2024	10:34 AM	128-01 Lactation Room A-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
8/21/2024	10:40 AM	128-02 Lactation Room B-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.2	
8/21/2024	10:45 AM	128-03 Lactation Room C-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
8/21/2024	10:50 AM	128-04 Lactation Room D-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
8/21/2024	11:05 AM	LL15 Men's Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/21/2024	11:15 AM	LL15 Women's Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/21/2024	11:25 AM	LL15 Break Room-Kitchen Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
8/21/2024	11:35 AM	Print, Postal Sorting Area Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.5	1.4	
8/21/2024	7:32 PM	126-02 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/21/2024	7:32 PM	126-02 Women-Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/21/2024	7:32 PM	126-02 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/21/2024	7:40 PM	126-03 Women-Shower-1st from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			0.5
8/21/2024	7:43 PM	126-03 Women-Shower-2nd from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.8
8/21/2024	7:46 PM	126-03 Women-Shower-3rd from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.1
8/21/2024	7:49 PM	126-03 Women-Shower-4th from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			2.2
8/21/2024	7:50 PM	126-05 Men-Lavatory Faucet-Left	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/21/2024	7:52 PM	126-05 Men-Lavatory Faucet-Center	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/21/2024	7:52 PM	126-05 Men-Lavatory Faucet-Right	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/21/2024	7:57 PM	126-06 Shower Room - Shower-North-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.6
8/21/2024	7:59 PM	126-06 Shower Room-Shower-North-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.2
8/21/2024	8:06 PM	126-06 Shower Room - Shower-South-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.4
8/21/2024	8:10 PM	126-06 Shower Room-Shower-South-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.4
8/21/2024	8:14 PM	126-06 Shower Room - Shower-South-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.2
8/21/2024	8:21 PM	126-06 Shower Room - Shower-North-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.5

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 08/18/2024 to 08/24/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
8/19/2024	2944410	Suite 1015 GSA Kitchenette Faucet (1000-03)
8/19/2024	2944136	C207 Janitor's Closet-Mop/Slop Sink
8/20/2024	2944419	Suite. 540 Kitchenette - Faucet
8/20/2024	2944290	Suite 620 Break Room-Kitchen Faucet (608-12)
8/20/2024	2945145	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)
8/20/2024	2944386	Suite 1010 Kitchenette Faucet
8/20/2024	2944385	Suite 1010 Lavatory Faucet
8/21/2024	2944222	Suite 415 Kitchenette - Faucet (N)
8/21/2024	2944094	119-08 Toilet/Sink Combo-Left
8/21/2024	2944095	119-08 Toilet/Sink Combo-Right
8/21/2024	2944091	119-10 Toilet/Sink Combo
8/21/2024	2944093	119-07 Toilet/Sink Combo-Right
8/21/2024	2944090	119-11 Toilet/Sink Combo
8/21/2024	2944087	119-16A Shower
8/21/2024	2944088	119-17 Toilet/Sink Combo

Rosa Parks Federal Building  
Weekly .2 Micron Filter Inspection Report  
From 08/25/2024 to 08/31/2024

**Definitions**

**Filter(s) Inspected:** When the box is checked, the filter was inspected for active leaks, evidence of leaks, and any defects cracks in filter casing  
**Filter(s) Replaced:** When the box is checked, a filter was replaced at this location on the date in the first column.


Date	Time	Floor	Location / Plumbing Outlet (For Publication)	Number of Filters	Filter(s) Inspected	Filter(s) Replaced	Design Flow Rate (GPM)	Cold Flow Rate (GPM)	Hot Flow Rate (GPM)	Mixed Flow Rate (GPM)
8/26/2024	12:03 AM		8W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:04 AM		8W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:05 AM		8W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:12 AM		8M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:13 AM		8M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:17 AM		8W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:18 AM		8W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:19 AM		8W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:25 AM		C807-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/26/2024	12:27 AM		7W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:30 AM		7W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:31 AM		7W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:45 AM		7M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.5
8/26/2024	12:46 AM		7M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:51 AM		7M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			2.3
8/26/2024	12:52 AM		7M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			2.6
8/26/2024	12:54 AM		7W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:55 AM		7W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	12:56 AM		7W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:06 AM		C707-Janitor's Closet-Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.5		
8/26/2024	1:11 AM		6W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:12 AM		6W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:13 AM		6W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:20 AM		6M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:21 AM		6M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:26 AM		6M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:27 AM		6M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:29 AM		6W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:30 AM		6W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:31 AM		6W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	1:40 AM		C607-Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/26/2024	2:45 AM		5W-1 Women's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	2:46 AM		5W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	2:47 AM		5W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	2:55 AM		5M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	2:56 AM		5M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:01 AM		C507 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.7		
8/26/2024	3:04 AM		5M-2 Men's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:05 AM		5M-2 Men's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:07 AM		5W-2 Women's Restroom West - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:08 AM		5W-2 Women's Restroom West - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:09 AM		5W-2 Women's Restroom West - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:38 AM		1M-2 Men's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:38 AM		1M-2 Men's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:39 AM		1W-1 Women's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:39 AM		1W-1 Women's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:39 AM		1W-1 Women's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:56 AM		1W-2 Women's Restroom South - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	3:56 AM		1W-2 Women's Restroom South - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	4:00 AM		C105-1 Janitor's Closet - Mop/Slop Sink	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.8		
8/26/2024	4:10 AM		114-2 Loading Dock - Janitor's Closet - Mop/Slop Sink	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		1.6		
8/26/2024	4:18 AM		1U-1 Loading Dock - Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	4:47 AM		1M-1 Men's Restroom North - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	4:49 AM		1M-1 Men's Restroom North - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	4:50 AM		1M-1 Men's Restroom North - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	4:57 AM		108-4 Cafe Prep. - Kitchen Faucet-Small	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.67	1.15	
8/26/2024	4:57 AM		108-4 Cafe Prep. - Kitchen Faucet-Large	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	0.68	1.18	
8/26/2024	5:25 AM		E201 Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	10:15 AM		Suite 1015 GSA Kitchenette Faucet (1000-03)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5		1.2	
8/26/2024	8:00 PM		4M-1 Men's Restroom East - Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	8:00 PM		4M-1 Men's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	8:03 PM		4W-1 Women's Restroom East - Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	8:05 PM		4W-1 Women's Restroom East - Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/26/2024	8:12 PM		4W-2 Women West-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48


8/26/2024	8:12 PM	4W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/26/2024	8:12 PM	4W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	8:15 PM	4W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	8:16 PM	C407 Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
8/26/2024	8:18 PM	4M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	8:18 PM	4M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	8:20 PM	3W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	8:20 PM	3W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/26/2024	8:22 PM	3W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	8:26 PM	3M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	8:26 PM	3M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	8:32 PM	3M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	8:36 PM	3W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	8:36 PM	3W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/26/2024	8:36 PM	3W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	8:45 PM	2M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	8:45 PM	2W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	8:45 PM	2W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/26/2024	8:45 PM	2W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	8:47 PM	2M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	8:49 PM	2M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	8:50 PM	2M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	8:52 PM	2W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	8:52 PM	2W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/26/2024	8:52 PM	2W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	9:00 PM	LLM-1 Men-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	9:02 PM	LLM-1 Men-Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	9:30 PM	CLL09-1 Janitor's Closet - Mop/Slop Sink	1	✓	□		1.7		
8/26/2024	10:06 PM	10M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	10:07 PM	10M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	10:11 PM	10W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/26/2024	10:12 PM	10W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	10:13 PM	10W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	10:22 PM	C1007-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.6		
8/26/2024	10:25 PM	10M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	10:26 PM	10M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	10:29 PM	10W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/26/2024	10:30 PM	10W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	10:31 PM	10W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	10:36 PM	LLW-1 Women-Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	10:36 PM	LLW-1 Women-Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	10:40 PM	9W-1 Women's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	10:41 PM	9W-1 Women's Restroom East - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/26/2024	10:42 PM	9W-1 Women's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	10:50 PM	9M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	10:51 PM	9M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	10:55 PM	9M-2 Men's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	10:56 PM	9M-2 Men's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	10:57 PM	9W-2 Women's Restroom West - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/26/2024	10:58 PM	9W-2 Women's Restroom West - Lavatory Faucet-Center	1	✓	□	0.5			0.48
8/26/2024	10:59 PM	9W-2 Women's Restroom West - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	11:13 PM	C907-Janitor's Closet-Mop/Slop Sink	1	✓	□		1.7		
8/26/2024	11:58 PM	8M-1 Men's Restroom East - Lavatory Faucet-Left	1	✓	□	0.5			0.48
8/26/2024	11:59 PM	8M-1 Men's Restroom East - Lavatory Faucet-Right	1	✓	□	0.5			0.48
8/27/2024	8:30 AM	Suite 608 Kitchen - Faucet	2	✓	□	1.5	13	1.2	
8/27/2024	8:40 AM	Suite 620 Break Room-Kitchen Faucet (608-12)	2	✓	□	1.5	1.2	1.2	
8/27/2024	8:40 AM	Suite 620 Break Room Kitchen - Faucet (608-12A) A (Second fixture)	1	✓	□	1.5	1.2	1.3	
8/27/2024	8:50 AM	Suite 614 Room-Kitchen Faucet (610-03)	2	✓	□	1.5	1.3	1.2	
8/27/2024	9:00 AM	Suite 707-10 Faucet (707-07)	2	✓	□	1.5	1.3	1.3	
8/27/2024	9:10 AM	Suite 710 Faucet (710-03)	2	✓	□	1.5	1.3	1.3	
8/27/2024	9:20 AM	Suite 707-01 Break Room - Faucet (707-2)	2	✓	□	1.5	1.2	1.2	
8/27/2024	9:20 AM	Suite 808A Break Room Faucet (809-02)	1	✓	✓	1.5	1.2	1.2	
8/27/2024	9:30 AM	Suite 810 Kitchen Faucet	1	✓	✓	1.5	1.2	1.3	
8/27/2024	9:40 AM	Suite 908 Break Room Faucet (908-15)	2	✓	✓	1.5	1.3	1.3	
8/27/2024	9:50 AM	Suite 907A Break Room Faucet (907-22)	2	✓	✓	1.5	1.2	1.3	
8/27/2024	10:00 AM	Suite 910A Faucet (910-05)	2	✓	✓	1.5	1.2	1.2	
8/27/2024	10:25 AM	Suite 1010 Kitchenette Faucet	2	✓	✓	1.5	1.2	1.2	
8/27/2024	10:35 AM	Suite 1010 Lavatory Faucet	1	✓	□	1.5			0.48
8/27/2024	11:15 AM	Suite 1009C Break Room-Kitchen Faucet (1009-19)	2	✓	✓	1.5	1.2	1.2	
8/27/2024	11:25 AM	Suite 1008 Break Room-Kitchen Faucet (1009-07)	2	✓	✓	1.5	1.2	1.3	
8/27/2024	11:35 AM	Suite 530 Kitchenette - Faucet (509-10)	2	✓	✓	1.5	1.2	1.2	
8/27/2024	12:50 PM	Suite 540 Kitchenette - Faucet (507-25)	2	✓	✓	1.5	1.2	1.2	
8/27/2024	1:00 PM	Suite 532 Lactation Room - Faucet	2	✓	✓	1.5	1.2	1.2	
8/27/2024	1:10 PM	Suite 535 Break Room-Kitchen Faucet (507-36)	2	✓	✓	1.5	1.2	1.3	


8/27/2024	1:20 PM	540 Faucet (507-26) A (Second fixture)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
8/27/2024	1:35 PM	Suite 540 CBP Open Area Kitchenette - Faucet (507-15)	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.2	1.2	
8/27/2024	1:45 PM	Suite 540 Training Lobby - Faucet (507-12)	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.3	1.2	
8/27/2024	1:55 PM	540 Faucet (507-26)	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.4	1.4	
8/28/2024	8:20 AM	Suite 420 Kitchenette - Faucet (NE) - South	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.15	1.2	
8/28/2024	8:33 AM	Suite 415 Kitchenette - Faucet (N)	2	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1.5	1.87	1.66	
8/28/2024	8:50 AM	Suite 416 Kitchenette - Faucet (NE) - North	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.07	1.11	
8/28/2024	9:05 AM	Suite 435 Kitchenette Faucet (SE)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.03	1.03	
8/28/2024	9:05 AM	Suite 435 Kitchenette Faucet (SE) A (Second fixture)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5		0.63	
8/28/2024	9:33 AM	234 Kitchen Faucet (209-04)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
8/28/2024	9:53 AM	Break Room North West - Kitchen Faucet (207-14)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.2	
8/28/2024	10:10 AM	Break Room North East Kitchen - Faucet (207-39)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.3	1.3	
8/28/2024	10:22 AM	Break Room South East Kitchen - Faucet (207-49)	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.07	1.07	
8/28/2024	11:25 AM	Print, Postal Sorting Area Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.00	1.66	
8/28/2024	11:49 AM	LL15 Women's Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/28/2024	12:07 PM	LL15 Break Room-Kitchen Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.03	0.96	
8/28/2024	12:13 PM	126-02 Women-Lavatory Faucet-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/28/2024	12:14 PM	126-02 Women-Lavatory Faucet-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/28/2024	12:15 PM	126-02 Women-Lavatory Faucet-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/28/2024	12:22 PM	126-03 Women-Shower-1st from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.8
8/28/2024	12:24 PM	126-03 Women-Shower-2nd from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.7
8/28/2024	12:26 PM	126-03 Women-Shower-3rd from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.7
8/28/2024	12:28 PM	126-03 Women-Shower-4th from L to R	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.8
8/28/2024	12:33 PM	126-05 Men-Lavatory Faucet-Left	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/28/2024	12:34 PM	126-05 Men-Lavatory Faucet-Center	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/28/2024	12:35 PM	126-05 Men-Lavatory Faucet-Right	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/28/2024	12:40 PM	126-06 Shower Room - Shower-North-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.6
8/28/2024	12:41 PM	126-06 Shower Room-Shower-North-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.7
8/28/2024	12:42 PM	126-06 Shower Room - Shower-North-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.8
8/28/2024	12:43 PM	126-06 Shower Room - Shower-South-Left	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.6
8/28/2024	12:44 PM	126-06 Shower Room-Shower-South-Center	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.5
8/28/2024	12:45 PM	126-06 Shower Room - Shower-South-Right	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	2			1.6
8/28/2024	1:39 PM	123-05 Health Unit - Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			1.15
8/28/2024	1:50 PM	123-07 Health Unit-Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/28/2024	2:00 PM	123-08 Health Unit-Lavatory Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/28/2024	2:02 PM	128-01 Lactation Room A-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.15	1.11	
8/28/2024	2:13 PM	128-02 Lactation Room B-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.15	
8/28/2024	2:24 PM	128-03 Lactation Room C-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.07	1.11	
8/28/2024	2:37 PM	128-04 Lactation Room D-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.07	1.07	
8/28/2024	2:50 PM	LL15 Men's Restroom - Lavatory Faucet	1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.5			0.48
8/28/2024	3:16 PM	GSA Suite Kitchenette-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.2	1.2	
8/28/2024	3:28 PM	113-6 JLL Kitchenette-Kitchen Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.5	1.76	1.66	
8/28/2024	9:48 PM	119-02 Mailroom - Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.00	2.00	
8/28/2024	9:48 PM	119-07 Toilet/Sink Combo-Left	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
8/28/2024	9:48 PM	119-08 Toilet/Sink Combo-Left	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
8/28/2024	9:48 PM	119-08 Toilet/Sink Combo-Right	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
8/28/2024	9:48 PM	119-10 Toilet/Sink Combo	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
8/28/2024	9:48 PM	119-07 Toilet/Sink Combo-Right	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
8/28/2024	9:48 PM	119-11 Toilet/Sink Combo	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
8/28/2024	9:48 PM	119-16A Shower	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>				1.7
8/28/2024	9:48 PM	119-17 Toilet/Sink Combo	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6			
8/28/2024	9:48 PM	119-19 Food Storage Room-Sink/Faucet	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>	1.6	2.00	2.00	
8/28/2024	9:48 PM	119-21 Faucet/Eyewash	2	<input checked="" type="checkbox"/>	<input type="checkbox"/>		2.00	2.00	






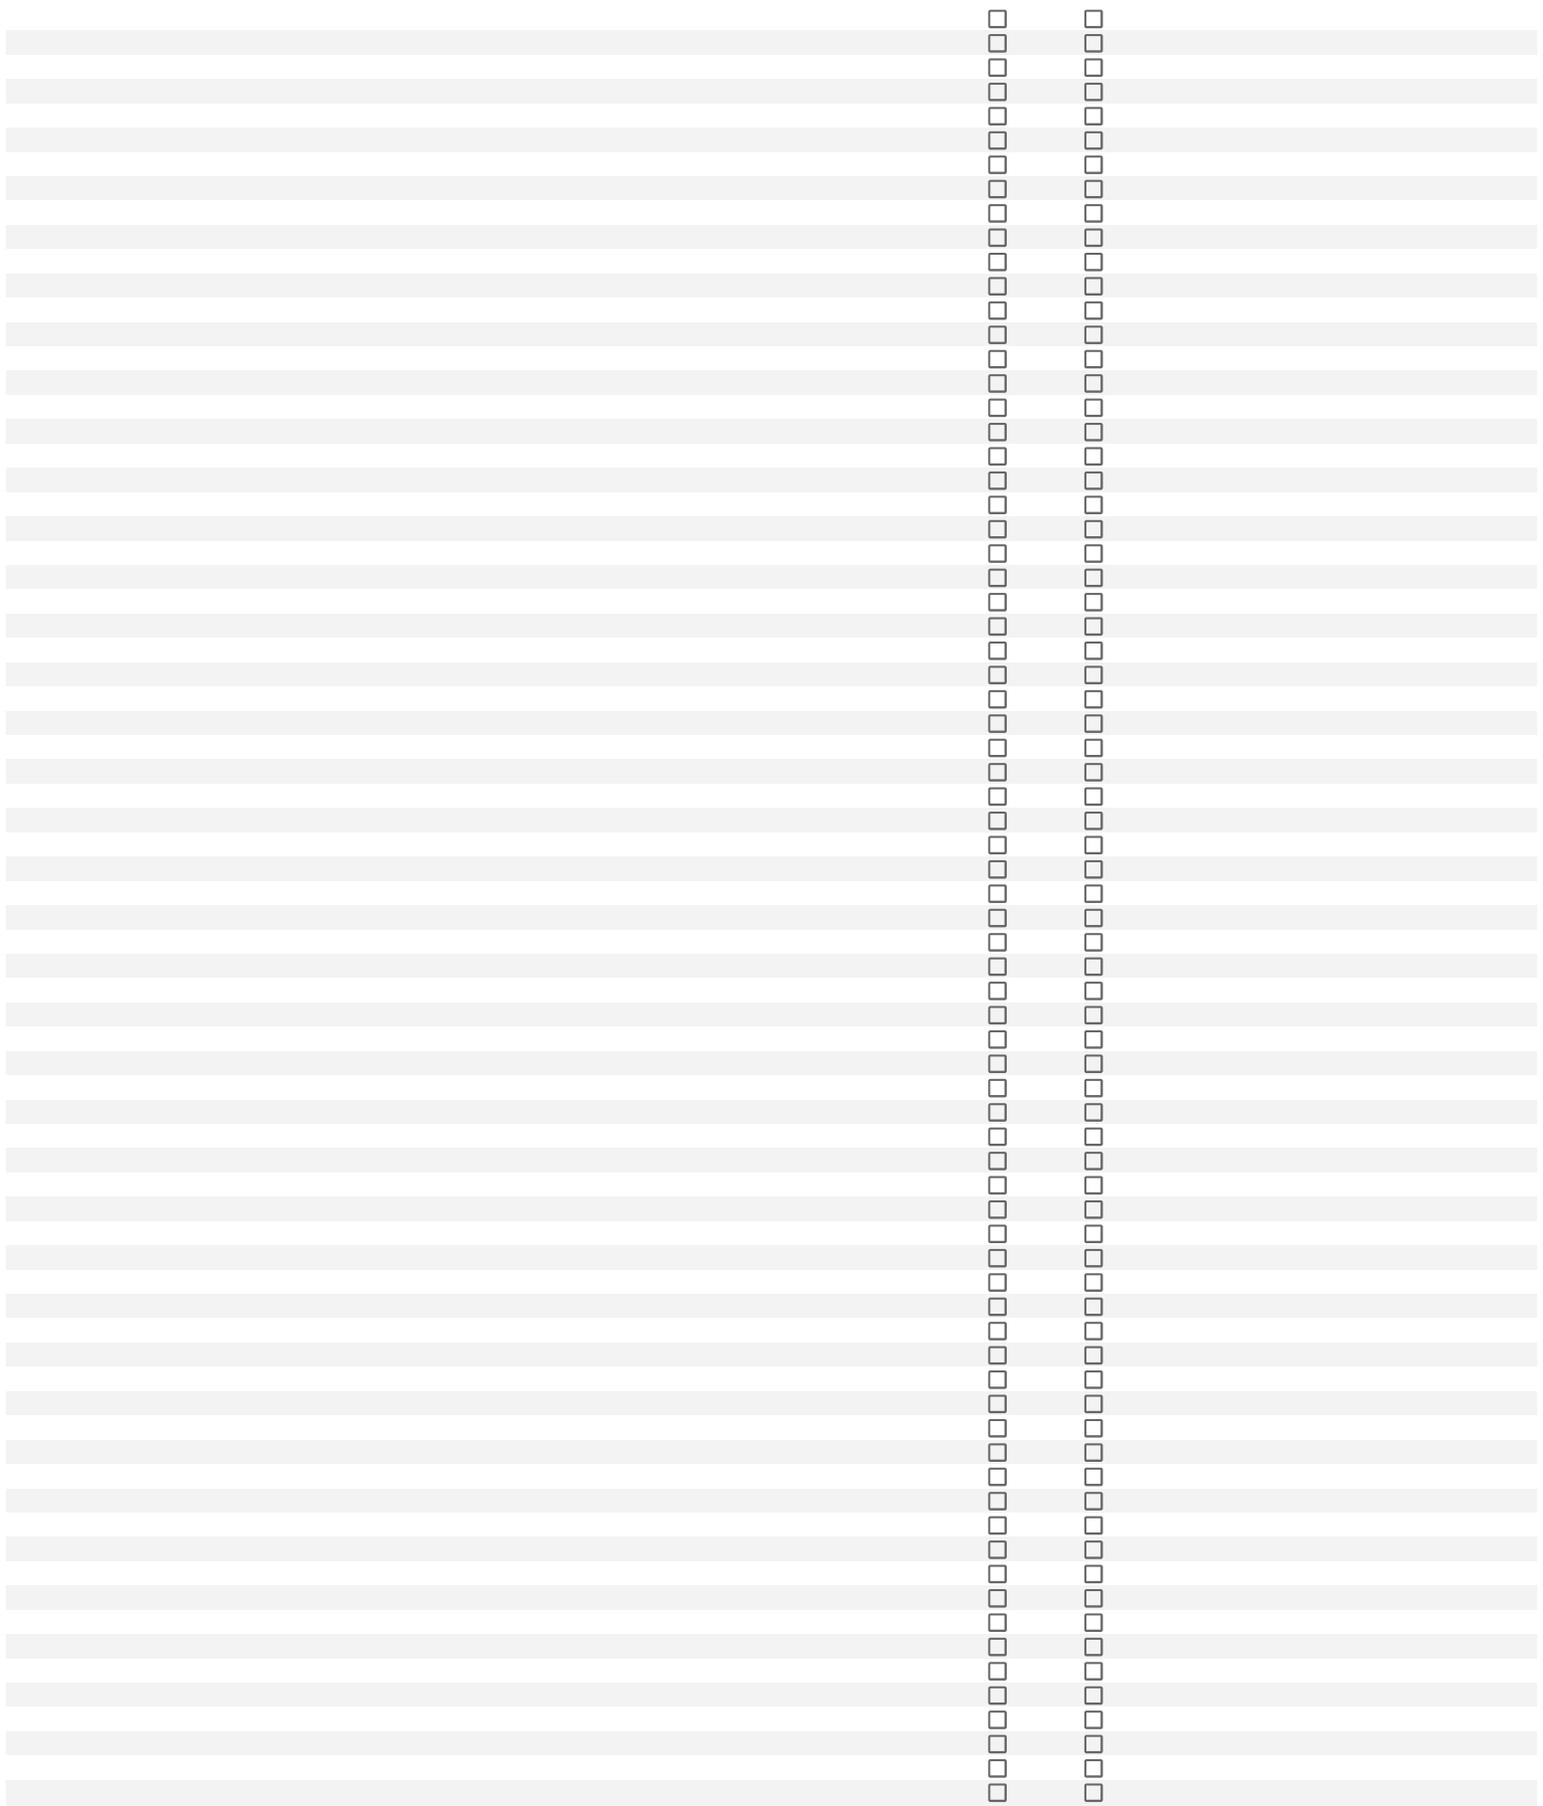

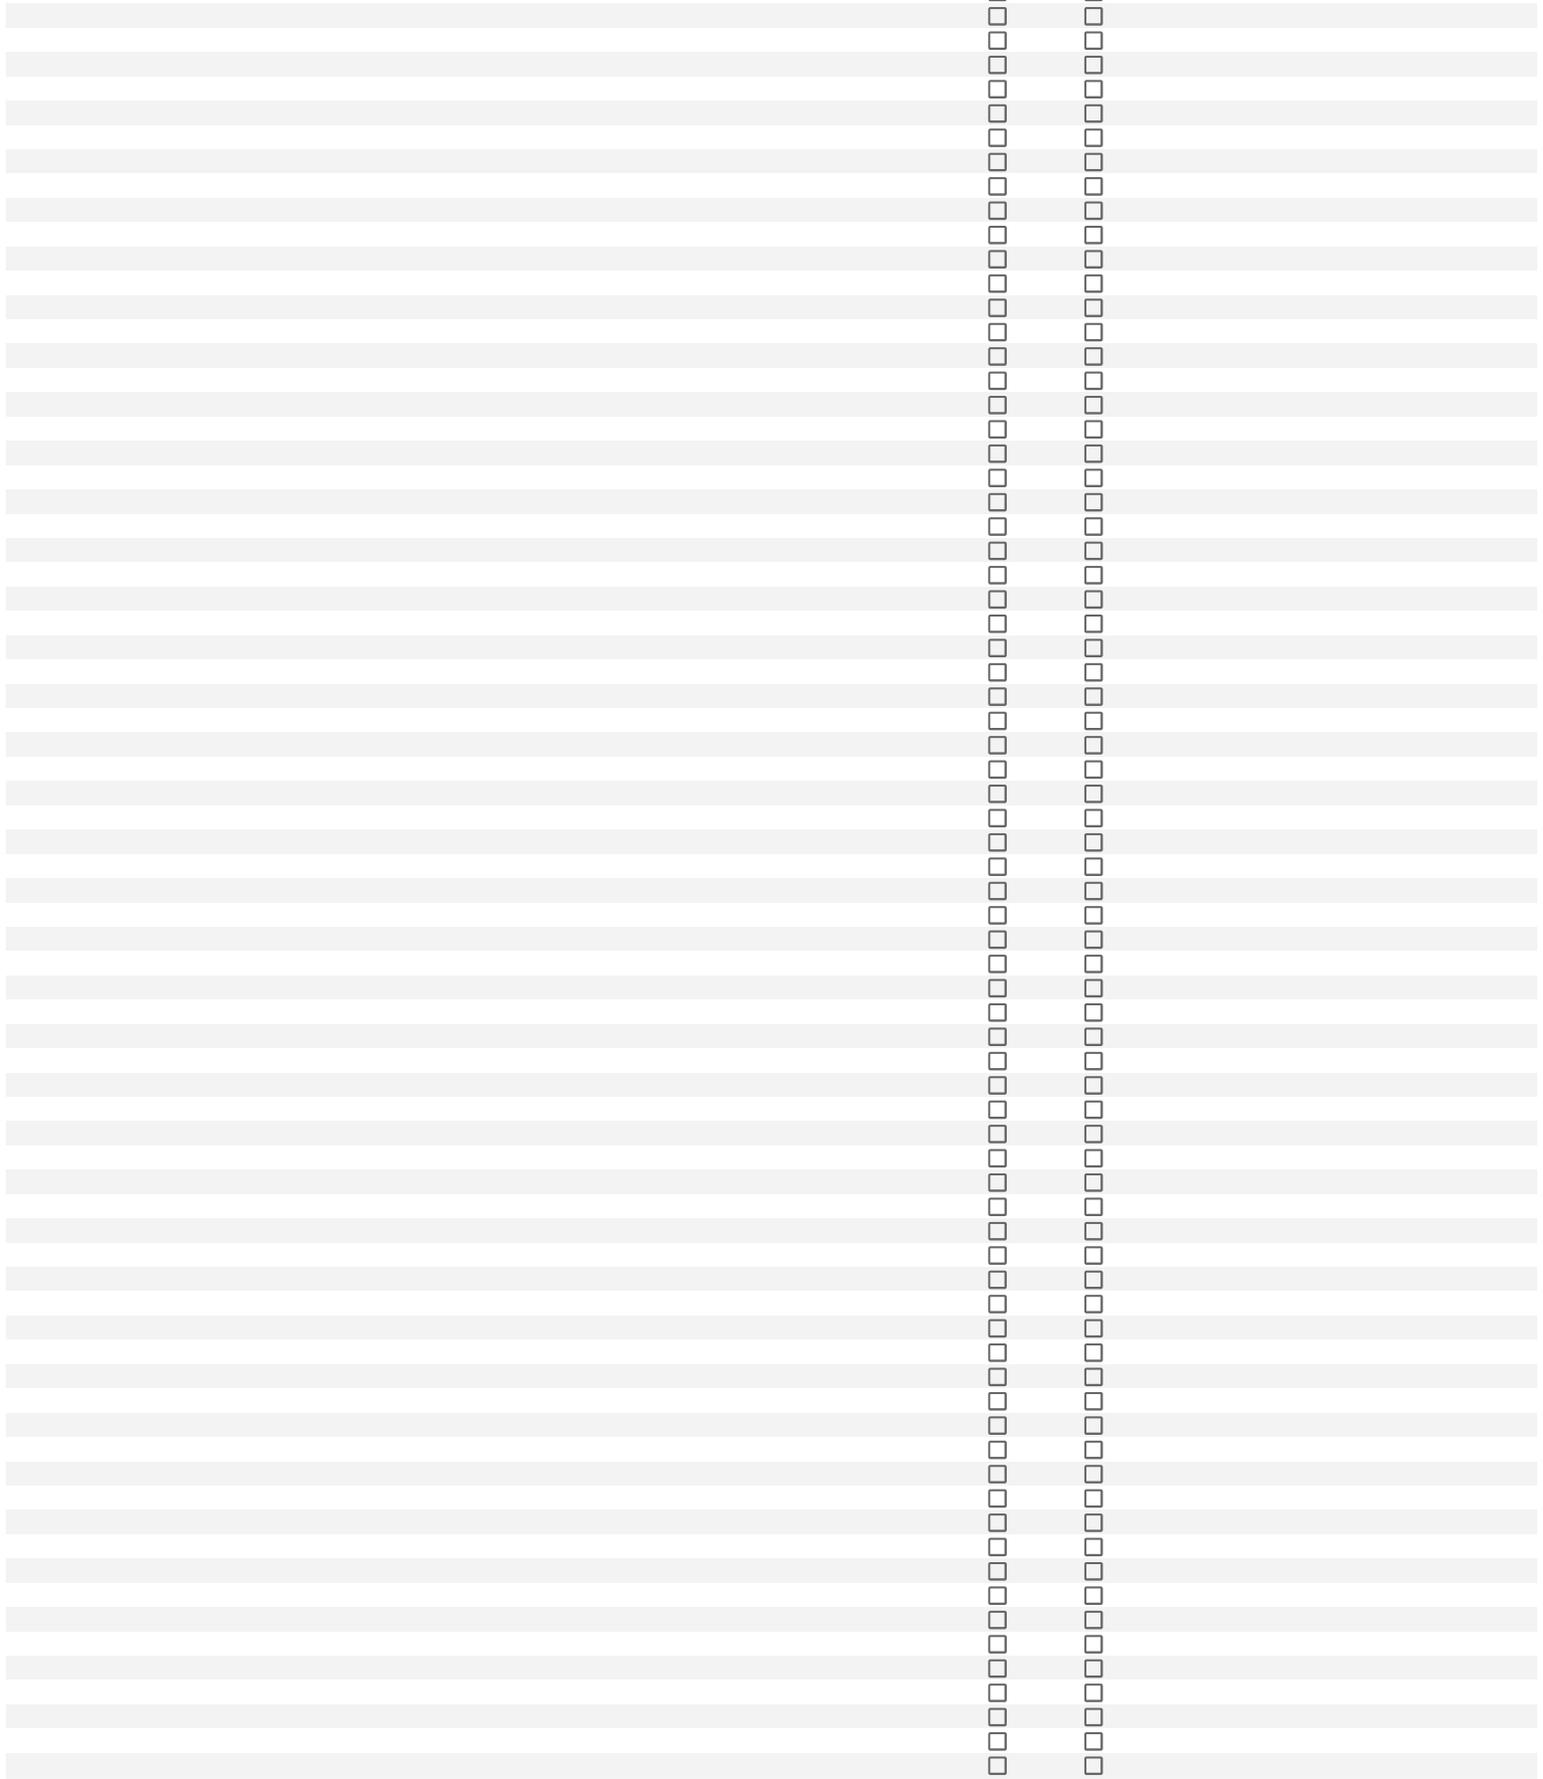

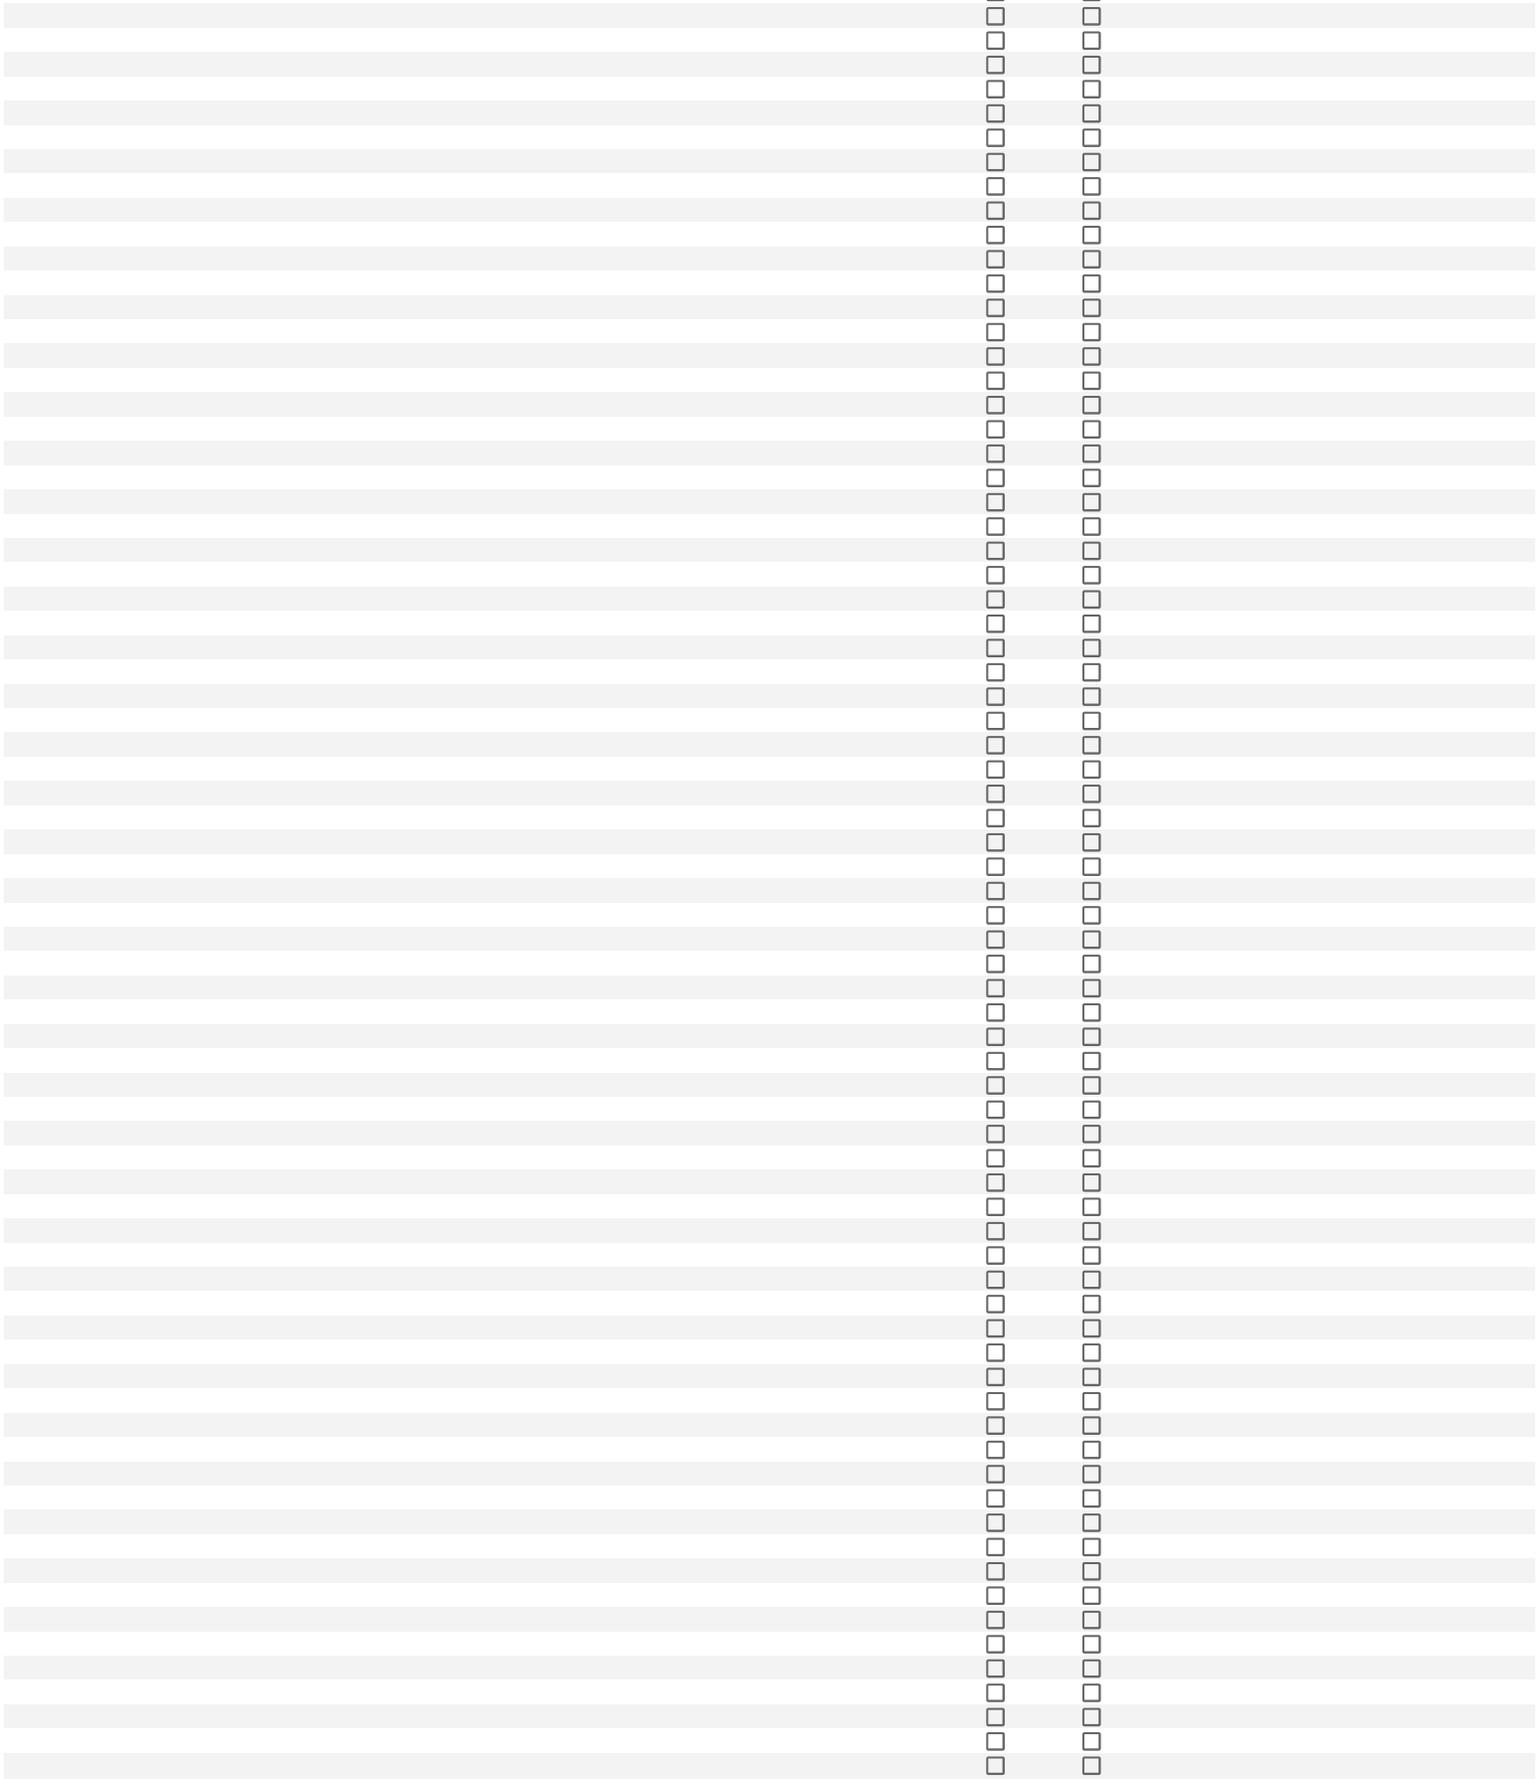

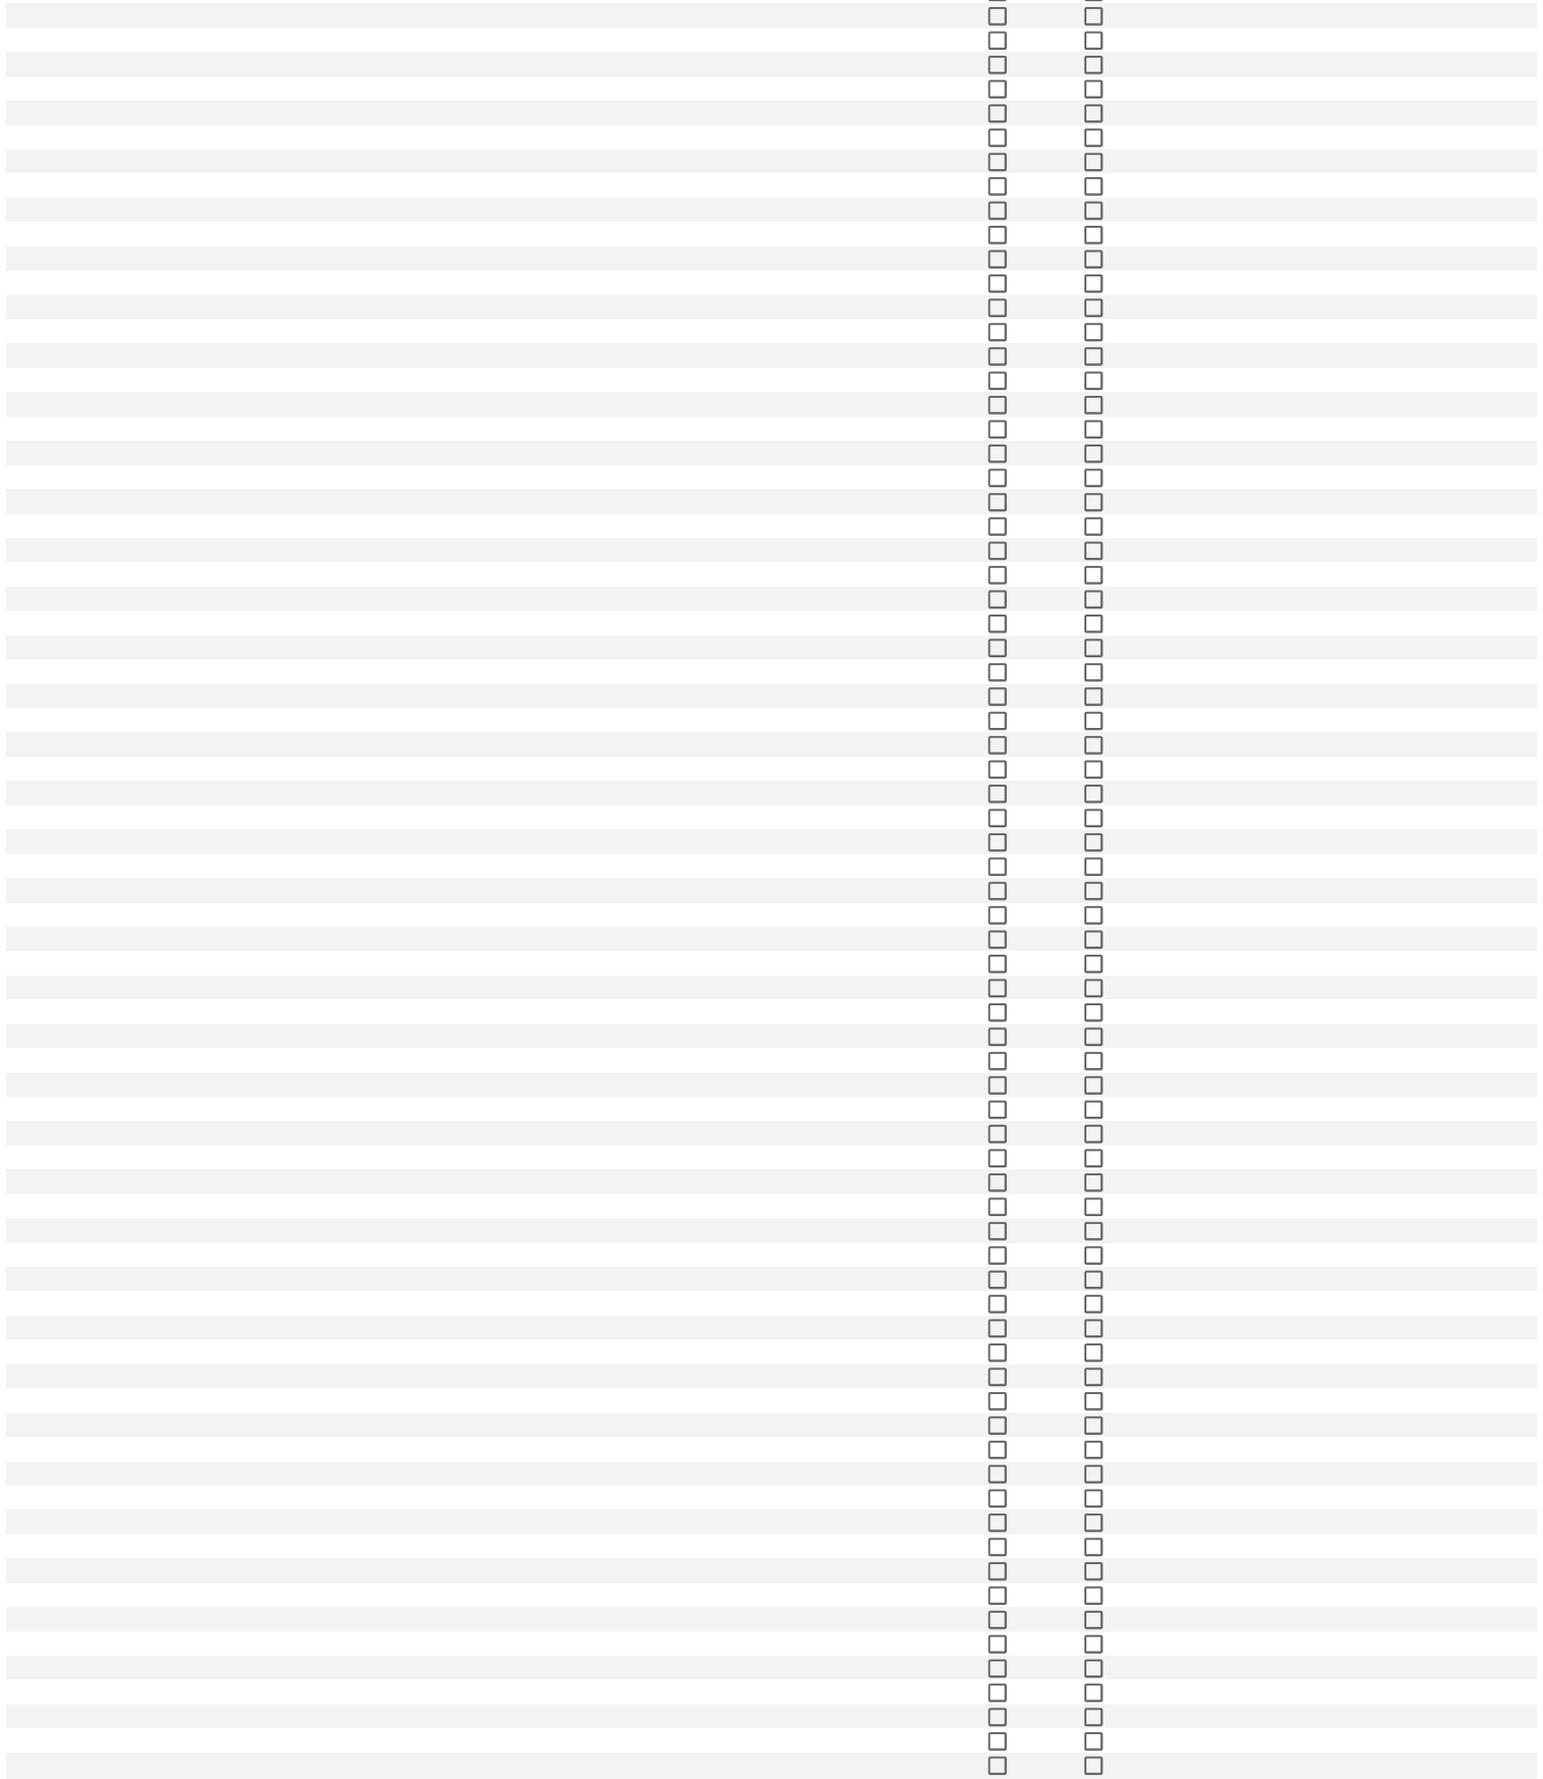

<input type="checkbox"/>	<input type="checkbox"/>

**Rosa Parks Federal Building**  
**Weekly .2 Micron Filter Inspection Exception Report**  
**From 08/25/2024 to 08/31/2024**

**There is no record of inspection for the fixtures/filters listed below for the planned inspection date. GSA is working with maintenance contractor to ensure all filters are inspected and inspections are logged accordingly.**

**Outlets w/Filters that are not included in the log**

<b>Planned Date</b>	<b>Asset Number</b>	<b>Publication Description</b>
8/26/2024	2944136	C207 Janitor's Closet-Mop/Slop Sink
8/27/2024	2944419	Suite. 540 Kitchenette - Faucet
8/27/2024	2944278	Suite 615 Break Room-Kitchen Faucet (607-06)
8/27/2024	2945143	Suite 615 Break Room-Kitchen Faucet (607-06A) A (Second fixture)
8/27/2024	2944260	Suite 520 Kitchenette Faucet (508-13)
8/28/2024	2944221	Suite 410 Kitchenette Faucet (NW)